

IES INDOOR REPORT

PHOTOMETRIC FILENAME : P4020-LED35-HO-D1.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002
[TEST] L041505601
[TESTLAB] LIGHT LABORATORY, INC.
[ISSUE DATE] 4/20/2015
[MANUFAC] PRUDENTIAL LTG.
[LUMCAT] P3920 or 4020-LED35-HO-D1
[LUMINAIRE] 26-1/4"DIA. X 5"H. LED LUMINAIRE
[MORE] DIFFUSED LENS
[BALLASTCAT] OSRAM OPTOTRONIC
[BALLAST] INPUT: 120-277VAC
[LAMPPOSITION] 0,0
[LAMPCAT] N/A
[OTHER] INDICATING THE CANDELA VALUES ARE ABSOLUTE AND
[MORE] SHOULD NOT BE FACTORED FOR DIFFERENT LAMP RATINGS.

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	7006
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	72
Total Luminaire Watts	97
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.26
Spacing Criterion (90-270)	1.26
Spacing Criterion (Diagonal)	1.36
Basic Luminous Shape	Circular
Luminous Length (0-180)	2.04 ft (Diameter)
Luminous Width (90-270)	2.04 ft (Diameter)
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	7585	7585	7585
55	7256	7256	7256
65	6868	6868	6868
75	5705	5705	5705
85	3571	3571	3571

IES INDOOR REPORT
PHOTOMETRIC FILENAME : P4020-LED35-HO-D1.IES

CANDELA TABULATION

	<u>0</u>
0	2499.2
5	2483.8
10	2448.6
15	2387.0
20	2307.8
25	2204.4
30	2085.6
35	1949.2
40	1797.4
45	1630.2
50	1454.2
55	1265.0
60	1089.0
65	882.2
70	664.4
75	448.8
80	248.6
85	94.6
90	0.0

IES INDOOR REPORT
PHOTOMETRIC FILENAME : P4020-LED35-HO-D1.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	909.78	N.A.	13.00
0-30	1925.93	N.A.	27.50
0-40	3145.17	N.A.	44.90
0-60	5538.44	N.A.	79.10
0-80	6886.82	N.A.	98.30
0-90	7005.98	N.A.	100.00
10-90	6769.96	N.A.	96.60
20-40	2235.39	N.A.	31.90
20-50	3493.29	N.A.	49.90
40-70	3264.07	N.A.	46.60
60-80	1348.39	N.A.	19.20
70-80	477.58	N.A.	6.80
80-90	119.16	N.A.	1.70
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	7005.98	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	236.02
10-20	673.76
20-30	1016.15
30-40	1219.24
40-50	1257.9
50-60	1135.37
60-70	870.81
70-80	477.58
80-90	119.16
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : P4020-LED35-HO-D1.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	94	91	89	90	88	86	84
2	99	91	84	78	96	89	82	77	85	80	75	82	77	74	79	75	72	70
3	90	80	71	65	88	78	70	64	75	68	63	72	67	62	70	65	61	59
4	82	70	62	55	80	69	61	54	67	59	54	64	58	53	62	57	52	50
5	76	63	54	47	74	62	53	47	60	52	46	58	51	46	56	50	45	43
6	70	57	48	41	68	56	47	41	54	46	41	52	45	40	51	45	40	38
7	65	51	43	36	63	51	42	36	49	41	36	48	41	36	46	40	35	33
8	60	47	38	32	59	46	38	32	45	37	32	44	37	32	42	36	32	30
9	56	43	35	29	55	42	34	29	41	34	29	40	34	29	39	33	29	27
10	53	40	32	26	52	39	32	26	38	31	26	37	31	26	36	30	26	24

IES INDOOR REPORT
PHOTOMETRIC FILENAME : P4020-LED35-HO-D1.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise


X=2H	Y=2H	18.3	19.9	18.7	20.2	20.6	18.3	19.9	18.7	20.2	20.6
	3H	20.1	21.6	20.5	21.9	22.3	20.1	21.6	20.5	21.9	22.3
	4H	20.7	22.1	21.1	22.5	22.8	20.7	22.1	21.1	22.5	22.8
	6H	21.1	22.4	21.6	22.8	23.2	21.1	22.4	21.6	22.8	23.2
	8H	21.2	22.5	21.7	22.9	23.3	21.2	22.5	21.7	22.9	23.3
	12H	21.3	22.5	21.8	22.9	23.3	21.3	22.5	21.8	22.9	23.3

UGR Viewed Endwise

4H	2H	19.0	20.3	19.3	20.7	21.1	19.0	20.3	19.3	20.7	21.1
	3H	20.9	22.1	21.4	22.5	22.9	20.9	22.1	21.4	22.5	22.9
	4H	21.7	22.7	22.1	23.2	23.6	21.7	22.7	22.1	23.2	23.6
	6H	22.2	23.1	22.7	23.6	24.0	22.2	23.1	22.7	23.6	24.0
	8H	22.4	23.2	22.8	23.7	24.1	22.4	23.2	22.8	23.7	24.1
	12H	22.5	23.3	23.0	23.7	24.2	22.5	23.3	23.0	23.7	24.2
8H	4H	22.0	22.8	22.4	23.3	23.7	22.0	22.8	22.4	23.3	23.7
	6H	22.6	23.3	23.1	23.8	24.3	22.6	23.3	23.1	23.8	24.3
	8H	22.8	23.5	23.3	24.0	24.5	22.8	23.5	23.3	24.0	24.5
	12H	23.0	23.6	23.5	24.0	24.6	23.0	23.6	23.5	24.0	24.6
12H	4H	22.0	22.8	22.5	23.3	23.7	22.0	22.8	22.5	23.3	23.7
	6H	22.7	23.3	23.2	23.8	24.3	22.7	23.3	23.2	23.8	24.3
	8H	22.9	23.5	23.4	24.0	24.5	22.9	23.5	23.4	24.0	24.5

Maximum UGR = 24.6

POLAR GRAPH

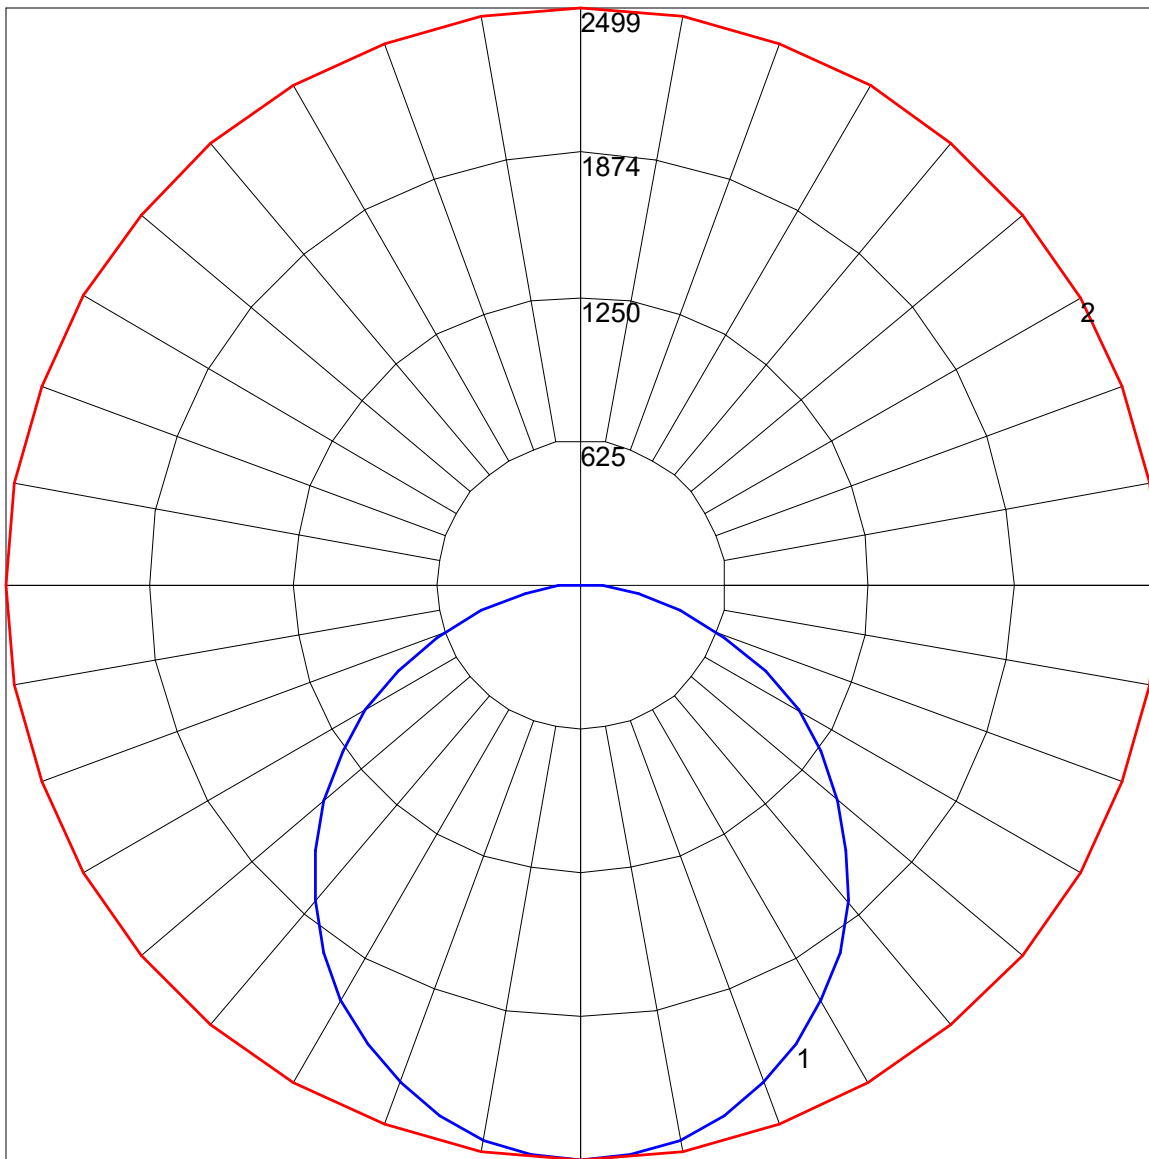

Maximum Candela = 2499.2 Located At Horizontal Angle = 0, Vertical Angle = 0
1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)