




## INSTALLATION INSTRUCTIONS

PRULITE.COM 213.746.0360

### T-BAR (X1)

#### MINIMUM MOUNTING DISTANCES:

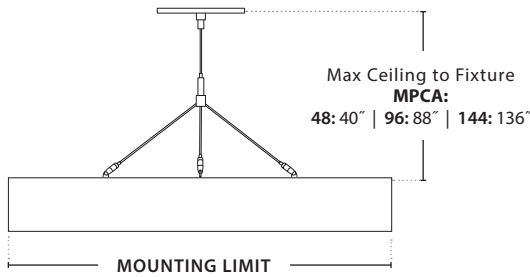

#### MINIMUM CEILING TO FIXTURE:

FIXTURE	18"-2'	3'-4'
P3900 + P4000	9"	18"
O + C	18"	18"
Olive	18"	24"

Electrical box must be attached to A.T. clip. Refer to nec 370-16 for maximum electrical box fill. Romex clamp and electrical box (by others).


## PARTS LIST

PART NUMBER	DESCRIPTION	QTY
106701	BioPro Access Plate	1
100-00004-08	I.D.S. Clip ( Standard)	1
100-00003-08	I.D.S. 95 Clip (Slot Grid Ceiling Option)	1
100-00091-08	Erico Caddy A.T Clip	1
100-00114-14	1/4-20 x 3/4" Phil Truss H.D. Screw	1
100-00063-08	Metal Strain Relief Bushing	1
100-00040-10	Snap Bushing (White) — 3 or 4 Wire	1
28975	5 1/2" Diameter Canopy (White) — 2-Hole	1
100-00238-14	1/2" x 1 1/4" Nipple	1
100-00239-14	1/2" I.P. Knurled Nut	1
100-00042-10	Threaded Bushing	1
100-00043-10	White Universal Bushing	1
100-00023-09	18 GA. 3 Wire SJT Cord 5'** or 9'***	1

#### CABLE SUPPORT ASSEMBLY KITS:

100-00021-08*	53"	Coupler with ___" Cable	1
		3-Way Cable Adapter	1
100-00024-08**	96"	1/4-20 Keps Lock Nut	3
		Pivoting Cable Glider	3

ASSEMBLY NUMBER — \*43034 (53" CABLE) / \*\*43042 (96" CABLE)

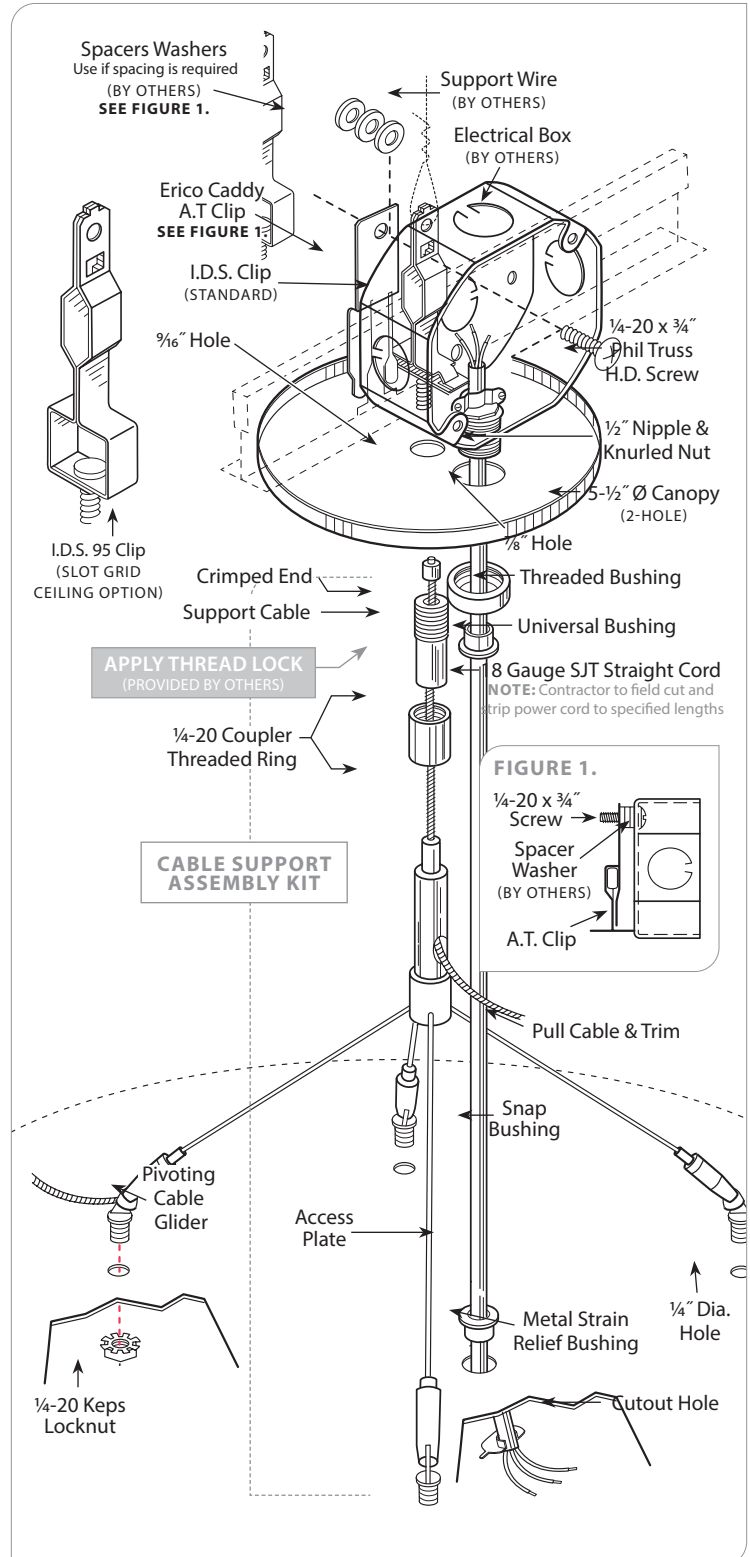


**WARNING:** Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury. Fixture Installations should ONLY be done by a qualified licensed electrical professional.



## INSTALLATION INSTRUCTIONS

### T-BAR (X1)

#### MINIMUM MOUNTING DISTANCES:

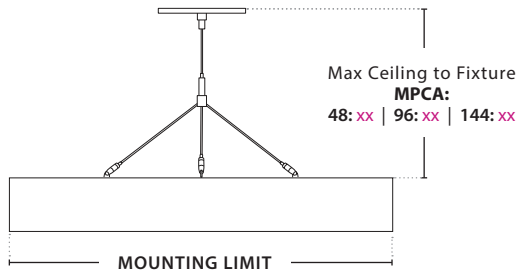

#### MINIMUM CEILING TO FIXTURE:

FIXTURE	18"-2'	3'-4'
P3900 + P4000	9"	18"
O + C	18"	18"
Olive	18"	24"

Mounting strap will accommodate a 4" octagon electrical box without plaster ring. Refer to nec 370-16 for maximum electrical box fill.

## PARTS LIST

PART NUMBER	DESCRIPTION	QTY
<b>MOUNTING STRAP KIT:</b>		
19031	Mounting Strap (X3)	1
	1/4-20 x 5/8" Pan Head Bolt	1
	1/4-20 Speed Nut	1
106701	BioPro Access Plate	
100-00063-10	Metal Strain Relief Bushing	1
100-00040-10	Snap Bushing (White) — 3 or 4 Wire	1
28975	5 1/2" Diameter Canopy (White) — 2-Hole	1
100-00238-14	1/2" x 1 1/4" Nipple	1
100-00239-14	1/2" I.P. Knurled Nut	1
100-00042-10	Threaded Bushing	1
100-00043-10	White Universal Bushing	1
100-00023-09	18 GA. 3 Wire SJT Cord 5" or 9"	1
<b>CABLE SUPPORT ASSEMBLY KITS:</b>		
100-00021-08*	53" Coupler with ___ Cable	1
	3-Way Cable Adapter	1
100-00028-08**	96" 1/4-20 Keps Lock Nut	3
	Pivoting Cable Glider	3

ASSEMBLY NUMBER — \*43035 (53" CABLE) / \*\*43041 (96" CABLE)

**WARNING:** Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury. Fixture installations should ONLY be done by a qualified licensed electrical professional.

