

PRUDENTIAL

TEST REPORT

SCOPE OF WORK

LED Performance Testing

MODEL NUMBER

BPRO5-PER-REG1-LED35-SO-4-WWF

PROJECT NUMBER

G104824537

REPORT NUMBER

104824537LAX-032

ISSUE DATE

September 27, 2021

REVISED DATE

None

TEST DATES

9/27/2021

DOCUMENT CONTROL NUMBER

RTTDS-R-AMER-Test-3407

© 2017 INTERTEK



REPORT NUMBER

104824537LAX-032

MODEL NUMBER(s)

BPRO5-PER-REG1-LED35-SO-4-WWF

REPORT RENDERED TO:

PRUDENTIAL

1774 EAST 21ST STREET

LOS ANGELES, CA 90058

STATEMENT OF LIMITATION

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government.

AUTHORIZATION

The testing performed was authorized by signed quote number Qu-01205890.

TEST STANDARDS

IESNA LM-79 - 2008: Electrical and Photometric Measurements of Solid State Lighting

In Charge of Testing:



Bryan Cubillo
Technician III
Lighting Division

Reviewer:



Vladimir Kozak
Engineering Supervisor
Lighting Division

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

SAMPLE INFORMATION

REPORT NO. 104824537LAX-032

ITEMS RECEIVED

| Item No. | Control No. | Model No. | Description | Type | Received |
|----------|---------------------|-------------|---------------|------------|----------|
| 1 | LAN2109231103-003 | BRO5 SERIES | LED Fixture | Production | 09/21/21 |
| 2 | LAN2109231103-003-A | REG1 | Regress Frame | Production | 09/21/21 |
| 3 | LAN2109231103-003-2 | WWF | Lens | Production | 09/21/21 |
| | | | | | |

TESTED SAMPLE CONFIGURATIONS

| Config No. | Tested Model No. | Item Nos. Utilized |
|------------|-------------------------------|--------------------|
| 1 | BPRO5-PER-REG1-LED35-SO-4-WWF | 1-3 |

SAMPLE PHOTOS - TESTED CONFIGURATIONS



SUMMARY

REPORT NO. 104824537LAX-032

PRODUCT INFORMATION AND SUMMARY OF DATA

| | |
|----------------------|--------------------------------|
| Product Model No.: | BPRO5-PER-REG1-LED35-SO-4-WWF |
| Product Description: | Flat Wall Wash LED Fixture |
| LED Model No.: | Lumileds 2835e 9V 3500K 80 CRI |
| Driver Model No.: | Osram OTI 50W G2 (832mA) |
| Light Source: | LED |

| Criteria | Results |
|------------------------------------|---------|
| Light Output (lumens) | 3907.1 |
| Input Power (W) @ 120 (Vac) | 31.51 |
| Lumen Efficacy (lm/W) | 124.0 |
| Input Power Factor (I) @ 120 (Vac) | 0.978 |

TEST METHODS

SEASONING IN SAMPLE ORIENTATION - LED PRODUCTS

No seasoning was performed in accordance with IESNA LM-79.

TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING

A Type C Mirror Goniophotometer system was used to measure the luminous intensity (candela) at each angle of distribution for the EUT. Electrical measurements of the unit were measured using a power analyzer. Each EUT was operated at the rated input voltage of the system in its designated orientation. The ambient temperature was measured at a position near the EUT at equal height and stabilization procedures to LM-79 were followed.

TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING

REPORT NO. 104824537LAX-032

| Test Configuration | Tested Model No. | Pass/Fail/NA |
|--------------------|-------------------------------|--------------|
| 1 | BPRO5-PER-REG1-LED35-SO-4-WWF | NA |


PHOTOMETRIC AND ELECTRICAL MEASUREMENTS (25°C +/- 1°C)

| Base Orientation | Input Voltage (Vac) | Input Current (mA) | Input Power (W) | Input Power Factor (I) | Input ATHD(%) |
|------------------|---------------------|--------------------|-----------------|------------------------|---------------|
| Up | 119.90 | 268.7 | 31.51 | 0.978 | 9.8 |

| Light Output (lm) | Lumen Efficacy (lm/W) |
|-------------------|-----------------------|
| 3907.1 | 124.0 |


INTENSITY SUMMARY - CANDELA

| | Angle | 0 | 22.5 | 45 | 67.5 | 90 |
|--|-------|------|-------|------|-------|------|
| | | | | | | |
| W A L L S I D E | 90 | 0 | 0 | 0 | 0 | 0 |
| | 85 | 41 | 37 | 38 | 38 | 57 |
| | 80 | 75 | 70 | 73 | 105 | 126 |
| | 75 | 110 | 110 | 142 | 185 | 201 |
| | 70 | 164 | 169 | 225 | 280 | 286 |
| | 65 | 228 | 238 | 321 | 402 | 394 |
| | 60 | 305 | 322 | 432 | 566 | 537 |
| | 55 | 397 | 424 | 568 | 784 | 714 |
| | 50 | 514 | 551 | 742 | 1046 | 905 |
| | 45 | 665 | 717 | 977 | 1331 | 1084 |
| | 40 | 882 | 953 | 1267 | 1620 | 1234 |
| | 35 | 1195 | 1274 | 1584 | 1892 | 1354 |
| | 30 | 1561 | 1622 | 1914 | 2113 | 1453 |
| | 25 | 1927 | 1982 | 2255 | 2233 | 1535 |
| | 20 | 2336 | 2375 | 2527 | 2235 | 1605 |
| | 15 | 2682 | 2670 | 2575 | 2154 | 1663 |
| | 10 | 2616 | 2574 | 2356 | 2027 | 1707 |
| | 5 | 2157 | 2153 | 2028 | 1883 | 1734 |
| R O O M S I D E | 0 | 1741 | 1741 | 1741 | 1741 | 1741 |
| | 5 | 1476 | 1502 | 1534 | 1615 | 1734 |
| | 10 | 1358 | 1374 | 1405 | 1506 | 1707 |
| | 15 | 1285 | 1299 | 1323 | 1409 | 1663 |
| | 20 | 1211 | 1232 | 1252 | 1324 | 1605 |
| | 25 | 1122 | 1149 | 1178 | 1244 | 1535 |
| | 30 | 1009 | 1046 | 1092 | 1160 | 1453 |
| | 35 | 863 | 912 | 990 | 1069 | 1354 |
| | 40 | 720 | 767 | 867 | 969 | 1234 |
| | 45 | 597 | 635 | 731 | 852 | 1084 |
| | 50 | 491 | 521 | 597 | 719 | 905 |
| | 55 | 400 | 422 | 477 | 577 | 714 |
| | 60 | 316 | 333 | 372 | 446 | 537 |
| | 65 | 229 | 251 | 281 | 334 | 394 |
| | 70 | 154 | 172 | 200 | 244 | 286 |
| | 75 | 102 | 112 | 129 | 167 | 201 |
| | 80 | 70 | 70 | 74 | 98 | 126 |
| | 85 | 34 | 40 | 40 | 39 | 57 |
| | 90 | 0 | 0 | 0 | 0 | 0 |
| | Angle | 180 | 202.5 | 225 | 247.5 | 270 |

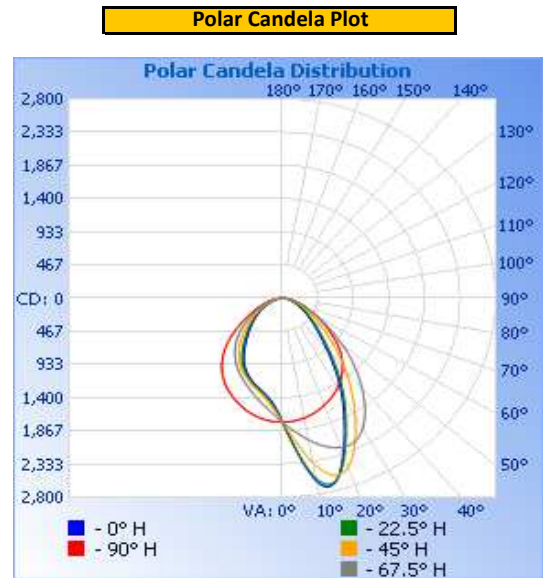

REPORT NO. 104824537LAX-032

ILLUMINANCE SUMMARY

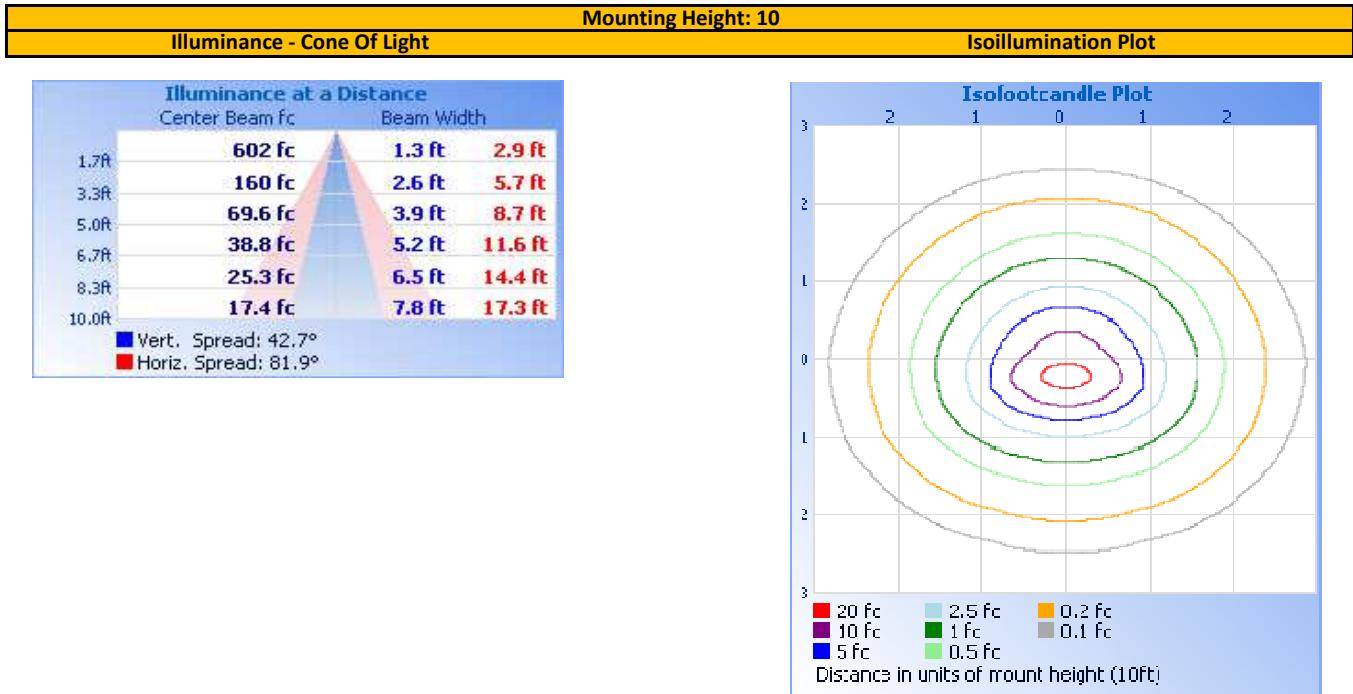

ZONAL LUMENS

| Zonal Lumen Summary | | | | | |
|---------------------|---------|-----------|---------|--------|-------|
| Zone | Lumens | Luminaire | Zone | Lumens | Total |
| 0-30 | 1,451.9 | 37.2% | 0-10 | 173.1 | 4.4% |
| 0-40 | 2,239.5 | 57.3% | 10-20 | 527.5 | 13.5% |
| 0-60 | 3,401.8 | 87.1% | 20-30 | 751.3 | 19.2% |
| 60-90 | 505.3 | 12.9% | 30-40 | 787.6 | 20.2% |
| 70-100 | 199.6 | 5.1% | 40-50 | 672.0 | 17.2% |
| 90-120 | 0.0 | 0.0% | 50-60 | 490.3 | 12.5% |
| 0-90 | 3,907.1 | 100.0% | 60-70 | 305.7 | 7.8% |
| 90-180 | 0.0 | 0.0% | 70-80 | 154.2 | 3.9% |
| 0-180 | 3,907.1 | 100.0% | 80-90 | 45.3 | 1.2% |
| | | | 90-100 | 0.0 | 0.0% |
| | | | 100-110 | 0.0 | 0.0% |
| | | | 110-120 | 0.0 | 0.0% |
| | | | 120-130 | 0.0 | 0.0% |
| | | | 130-140 | 0.0 | 0.0% |
| | | | 140-150 | 0.0 | 0.0% |
| | | | 150-160 | 0.0 | 0.0% |
| | | | 160-170 | 0.0 | 0.0% |
| | | | 170-180 | 0.0 | 0.0% |

SPACING CRITERION

| | |
|------------------------------|------|
| Spacing Criterion (0-180) | 1.26 |
| Spacing Criterion (90-270) | 1.26 |
| Spacing Criterion (Diagonal) | 1.24 |

LUMINANCE DATA - AVERAGE LUMINANCE (cd/m²)

| Angle | 0 | 45 | 90 |
|-------|------|------|-------|
| 45 | 6263 | 9202 | 10210 |
| 55 | 4610 | 6595 | 8290 |
| 65 | 3593 | 5059 | 6209 |
| 75 | 2831 | 3654 | 5172 |
| 85 | 3133 | 2904 | 4356 |

EQUIPMENT LIST

REPORT NO. 104824537LAX-032

| # | Equipment | Model No | Control No. | Last Cal | Cal Due |
|----|------------------|-------------|-------------|----------|----------|
| 1 | Goniophotometer | 6440T | 000943 | VBV | VBV |
| 2 | AC Source | CW1251P | 000944 | VBV | VBV |
| 3 | Power Analyzer | WT210 | 000945 | 09/21/21 | 09/21/22 |
| 4 | Tape Measure | 33-428 | 002225 | 08/23/21 | 08/23/22 |
| 5 | Thermometer | DPI8-C24 | 001782 | 09/22/21 | 09/22/22 |
| 6 | Digital Level | 1435-1000D | 002231 | VBV | VBV |
| 7 | Temp. & RH Meter | Fluke 1620A | 002195 | 12/17/20 | 12/27/21 |
| 8 | | | | | |
| 9 | | | | | |
| 10 | | | | | |
| 11 | | | | | |
| 12 | | | | | |
| 13 | | | | | |
| 14 | | | | | |
| 15 | | | | | |
| 16 | | | | | |
| 17 | | | | | |
| 18 | | | | | |
| 19 | | | | | |
| 20 | | | | | |
| 21 | | | | | |
| 22 | | | | | |
| 23 | | | | | |
| 24 | | | | | |
| 25 | | | | | |
| 26 | | | | | |
| 27 | | | | | |
| 28 | | | | | |
| 29 | | | | | |
| 30 | | | | | |

REVISION HISTORY

| # | Revision Date | Updated By | Reviewed BY | Description of Change |
|-----|---------------|------------|-------------|-----------------------|
| --- | None | --- | --- | --- |
| --- | --- | --- | --- | --- |
| --- | --- | --- | --- | --- |