



BionicPro | Linear

Cable Hung

INSTALLATION INSTRUCTIONS





PRUDENTIAL LTG.














PRULITE.COM 213.746.0360

PART	PART NO.	DESCRIPTION
------	----------	-------------


OPTICS & LOUVERS:

	100-00472-10	Soft Asymmetric Ceiling Wash
	100-00471-10	Soft Ceiling Wash
	100-00186-10	Plastic Lens Holder
	100-00321-02	Reflector
	100-00479-10	Top Glow Lens
	100-01002-18 CLEAR 100-00885-18 FROSTED	Acrylic Dust Cover
	100-00333-14	Plastic Push-In Fasteners
	100-00374-07 2" 100-00375-07 3" 100-00376-10 4" 100-00377-07 5"	Louver
	100-00353-14	#4-40 x 1/4 Flat Head Screw (Painted)

















TOGGLE CABLE ASSEMBLY:

	100-00119-08	53"
	100-00120-08	100"
	100-00121-08	200"
	100-00262-14	3/4 WIRE
	100-00264-14	5/6 WIRE
	100-00319-14	WHITE
	100-00316-14	BLACK
	100-00318-14	WHITE
	100-00321-14	BLACK
	100-00320-14	WHITE
	100-00322-14	WHITE
	100-00358-14	BLACK
	100-00356-14	BLACK



18GA SJT CORD:

	3 WIRE	4 WIRE	5 WIRE	6 WIRE
	WHITE 100-00023-09	100-00024-09	100-00912-09	100-01002-09
	WHITE 600v 100-00059-09	100-00060-09	100-00919-09	100-00604-09
	BLACK 100-00956-09	100-00025-09	100-00933-09	100-00317-09
	BLACK 600v 100-00318-09	100-00606-09	100-00457-09	100-00607-09


PART	PART NO.	DESCRIPTION
------	----------	-------------

	100-00003-08	I.D.S. 95 Clip (X2, X6 — Optional)
	100-00004-08	I.D.S. Clip (X1 Standard)
	100-00091-08	A.T Clip
	28975	5 1/2" Ø SPF Canopy (2 Hole)
	65392	5 1/2" Ø DPF Canopy (3 Hole)
	100-00284-14	1/2" x 1 1/8" IPT Brass Threaded Nipple
	100-00239-14	1/2" IP Knurled Nut
	100-00114-14	1/4-20 x 3/4" Truss Head Screw
	100-00283-14	1/4-20 x 5.0 Round Head Combination Drive Machine Screw
	100-00255-14	1/4-20 KEPS Hex Nut
	100-00486-10	Seam Reflector
	100-00462-10	2" — BionicPro Lens Tool — White
	100-00464-10	3" — BionicPro Lens Tool — Natural
	100-00465-10	4" — BionicPro Lens Tool — Black
	100-00463-10	5" — BionicPro Lens Tool — White
	100-00040-20	Tape Strips


X3 ONLY:

	100-00006-08	5 1/2" Ø NPF Canopy X3 (1 Hole)
	19031	Mounting Strap

X1/X2/X6 ONLY:

	100-00078-07	2" Ø NPF Canopy X1, X2, X6 (1 Hole)
-------------------------------------------------------------------------------------	--------------	-------------------------------------

ENDPLATE REFLECTOR:

	2" — 100-00482-10
	3" — 100-00483-10
	4" — 100-00484-10
	5" — 100-00485-10

FOR NON-WHITE
FIXTURES ONLY

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



BionicPro | Linear Cable Hung


INSTALLATION INSTRUCTIONS






PRUDENTIAL LTG.


PRULITE.COM 213.746.0360

LRT (LINEAR TO RECESSED TRANSITION PLATES):

	Direct to REC/PER	Direct/Indirect to REC/PER
 2" —	135770	135774
3" —	135771	135775
4" —	135772	135776
5" —	135773	135777

FTR (FEATHERING DIFFUSER):

	100-00843-10	Diffuser
	100-00374-14	Nylon Spacer Washer
	100-00182-14	6-32 x 1/2" Screw

PARTS LIST	SIZE	PART NO.						
LENSES:		SAL	BTW	WWF	PFL/WWG	NGZ	MGZ	WGZ
	2" —	100-00966-18	100-00961-18	100-00973-18	100-00978-18	100-00983-18	100-01004-18	100-00988-18
	3" —	100-00967-18	100-00962-18	100-00974-18	100-00979-18	100-00984-18	100-01005-18	100-00989-18
	4" —	100-00968-18	100-00963-18	100-00975-18	100-00980-18	100-00985-18	100-01006-08	100-00990-18
	5" —	100-00969-18	100-00964-18	100-00976-18	100-00981-18	100-00986-18	100-01007-18	100-00991-18

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



BionicPro | Linear Cable Hung

INSTALLATION INSTRUCTIONS





PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

MOUNTING LOCATIONS:

CABLE MOUNT

☐ POWER FEED

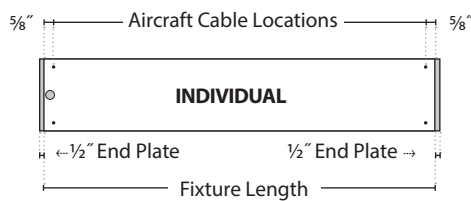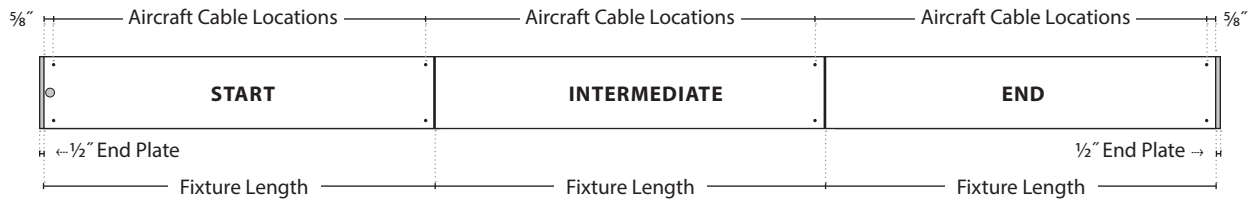

	FIXTURE LENGTHs	Aircraft cable locations	
	All	Start / Individual	Intermediate / End
2'	24"	22¾"	24"
3'	36"	34¾"	36"
4'	48"	46¾"	48"
5'	60"	58¾"	60"
6'	72"	70¾"	72"
7'	84"	82¾"	84"
8'	96"	94¾"	96"

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



BionicPro | Linear

Cable Hung

INSTALLATION INSTRUCTIONS




PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

18' STANDARD ROW LENGTH:



18' SYMMETRIC ROW LENGTH (SRL):



STANDARD

ROW LENGTH		
9'	5+4	5FT STR + 4FT END
10'	6+4	6FT STR + 4FT END
11'	7+4	7FT STR + 4FT END
12'	8+4	8FT STR + 4FT END
13'	8+5	8FT STR + 5FT END
14'	8+6	8FT STR + 6FT END
15'	8+7	8FT STR + 7FT END
16'	8+8	8FT STR + 8FT END
17'	8+5+4	8FT STR + 5FT INT + 4FT END
18'	8+6+4	8FT STR + 6FT INT + 4FT END
19'	8+7+4	8FT STR + 7FT INT + 4FT END
20'	8+8+4	8FT STR + 8FT INT + 4FT END
21'	8+8+5	8FT STR + 8FT INT + 5FT END
22'	8+8+6	8FT STR + 8FT INT + 6FT END
23'	8+8+7	8FT STR + 8FT INT + 7FT END
24'	8+8+8	8FT STR + 8FT INT + 8FT END
25'	8+8+5+4	8FT STR + 8FT INT + 5FT INT + 4FT END
26'	8+8+6+4	8FT STR + 8FT INT + 6FT INT + 4FT END
27'	8+8+7+4	8FT STR + 8FT INT + 7FT INT + 4FT END
28'	8+8+8+4	8FT STR + (2) 8FT INT + 4FT END
29'	8+8+8+5	8FT STR + (2) 8FT INT + 5FT END
30'	8+8+8+6	8FT STR + (2) 8FT INT + 6FT END
31'	8+8+8+7	8FT STR + (2) 8FT INT + 7FT END
32'	8+8+8+8	8FT STR + (2) 8FT INT + 8FT END
33'	8+8+8+5+4	8FT STR + (2) 8FT INT + 5FT INT + 4FT END
34'	8+8+8+6+4	8FT STR + (2) 8FT INT + 6FT INT + 4FT END
35'	8+8+8+7+4	8FT STR + (2) 8FT INT + 7FT INT + 4FT END
36'	8+8+8+8+4	8FT STR + (3) 8FT INT + 4FT END
37'	8+8+8+8+5	8FT STR + (3) 8FT INT + 5FT END
38'	8+8+8+8+6	8FT STR + (3) 8FT INT + 6FT END
39'	8+8+8+8+7	8FT STR + (3) 8FT INT + 7FT END
40'	8+8+8+8+8	8FT STR + (3) 8FT INT + 8FT END
41'	8+8+8+8+5+4	8FT STR + (3) 8FT INT + 5FT INT + 4FT END
42'	8+8+8+8+6+4	8FT STR + (3) 8FT INT + 6FT INT + 4FT END
43'	8+8+8+8+7+4	8FT STR + (3) 8FT INT + 7FT INT + 4FT END
44'	8+8+8+8+8+4	8FT STR + (4) 8FT INT + 4FT END
45'	8+8+8+8+8+5	8FT STR + (4) 8FT INT + 5FT END
46'	8+8+8+8+8+6	8FT STR + (4) 8FT INT + 6FT END
47'	8+8+8+8+8+7	8FT STR + (4) 8FT INT + 7FT END
48'	8+8+8+8+8+8	8FT STR + (4) 8FT INT + 8FT END
49'	8+8+8+8+8+5+4	8FT STR + (4) 8FT INT + 5FT INT + 4FT END
50'	8+8+8+8+8+6+4	8FT STR + (4) 8FT INT + 6FT INT + 4FT END

SYMMETRICAL

ROW LENGTH		
9'	3+3+3	3FT STR + 3FT INT + 3FT END
10'	5+5	5FT STR + 5FT END
11'	4+3+4	4FT STR + 3FT INT + 4FT END
12'	6+6	6FT STR + 6FT END
13'	4+5+4	4FT STR + 5FT INT + 4FT END
14'	7+7	7FT STR + 7FT END
15'	5+5+5	5FT STR + 5FT INT + 5FT END
16'	8+8	8FT STR + 8FT END
17'	6+5+6	6FT STR + 5FT INT + 6FT END
18'	6+6+6	6FT STR + 6FT INT + 6FT END
19'	6+7+6	6FT STR + 7FT INT + 6FT END
20'	8+4+8	8FT STR + 4FT INT + 8FT END
21'	8+5+8	8FT STR + 5FT INT + 8FT END
22'	8+6+8	8FT STR + 6FT INT + 8FT END
23'	8+7+8	8FT STR + 7FT INT + 8FT END
24'	8+8+8	8FT STR + 8FT INT + 8FT END
25'	6+4+5+4+6	6FT STR + 4FT INT + 5FT INT + 4FT INT + 6FT END
26'	8+5+5+8	8FT STR + (2) 5FT INT + 8FT END
27'	6+5+5+5+6	6FT STR + (3) 5FT INT + 6FT END
28'	8+6+6+8	8FT STR + (2) 6FT INT + 8FT END
29'	8+4+5+4+8	8FT STR + 4FT INT + 5FT INT + 4FT INT + 8FT END
30'	8+7+7+8	8FT STR + (2) 7FT INT + 8FT END
31'	8+5+5+5+8	8FT STR + (3) 5FT INT + 8FT END
32'	8+8+8+8	8FT STR + (2) 8FT INT + 8FT END
33'	8+6+5+6+8	8FT STR + 6FT INT + 5FT INT + 6FT INT + 8FT END
34'	8+6+6+6+8	8FT STR + 6FT INT + 6FT INT + 6FT INT + 8FT END
35'	8+6+7+6+8	8FT STR + 6FT INT + 7FT INT + 6FT INT + 8FT END
36'	8+8+4+8+8	8FT STR + 8FT INT + 4FT INT + 8FT INT + 8FT END
37'	8+8+5+8+8	8FT STR + 8FT INT + 5FT INT + 8FT INT + 8FT END
38'	8+8+6+8+8	8FT STR + 8FT INT + 6FT INT + 8FT INT + 8FT END
39'	8+8+7+8+8	8FT STR + 8FT INT + 7FT INT + 8FT INT + 8FT END
40'	8+8+8+8+8	8FT STR + (3) 8FT INT + 8FT END
41'	8+6+4+5+4+6+8	8FT STR + 6FT INT + 4FT INT + 5FT INT + 4FT INT + 6FT INT + 8FT END
42'	8+8+5+5+8+8	8FT STR + 8FT INT + (2) 5FT INT + 8FT INT + 8FT END
43'	8+6+5+5+5+6+8	8FT STR + 6FT INT + (3) 5FT INT + 6FT INT + 8FT END
44'	8+8+6+6+8+8	8FT STR + 8FT INT + (2) 6FT INT + 8FT INT + 8FT END
45'	8+8+4+5+4+8+8	8FT STR + 8FT INT + 4FT INT + 5FT INT + 4FT INT + 8FT INT + 8FT END
46'	8+8+7+7+8+8	8FT STR + 8FT INT + (2) 7FT INT + 8FT INT + 8FT END
47'	8+8+5+5+5+8+8	8FT STR + 8FT INT + (3) 5FT INT + 8FT INT + 8FT END
48'	8+8+8+8+8+8	8FT STR + (4) 8FT INT + 8FT END
49'	8+8+6+5+6+8+8	8FT STR + 8FT INT + 6FT INT + 5FT INT + 6FT INT + 8FT INT + 8FT END
50'	8+8+6+6+6+8+8	8FT STR + 8FT INT + (3) 6FT INT + 8FT INT + 8FT END







PIF INSTALLATION: PRE-INSTALLED INDIVIDUAL FIXTURE


REQUIRES TWO PEOPLE TO INSTALL

1) Install Griplock 'Y' toggle cables to hang fixtures.

DIRECT


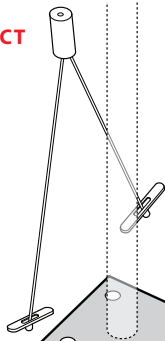


INDIRECT

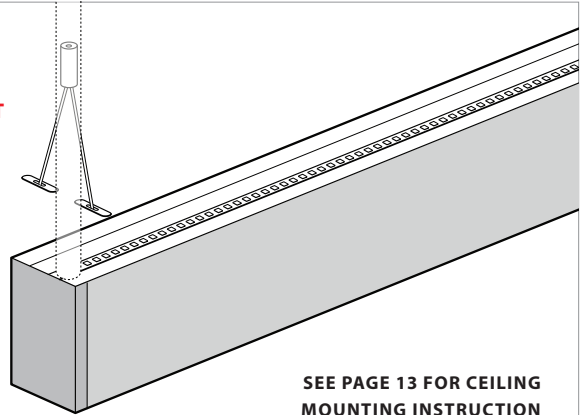

SEE PAGE 13 FOR CEILING MOUNTING INSTRUCTION

2) Hang fixtures with Griplock 'Y' cables.

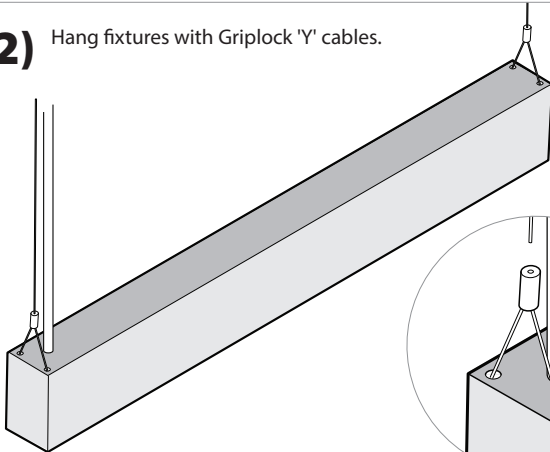

3) Make all wiring connections in ceiling (see table).


WIRING:

0-10V (+) : Purple	0-10V (-) : Grey
DALI (+) : Purple	DALI (-) : GREY
EcoSystem DALI (+): Purple	EcoSystem DALI (-) : GREY
HOT : BLACK	
NEUTRAL : WHITE	
GROUND : GREEN	
CONSTANT HOT (EM) : RED	



INDIVIDUAL

1) Remove screws and reflectors from all fixtures and disconnect wires for LEDs.

DIRECT

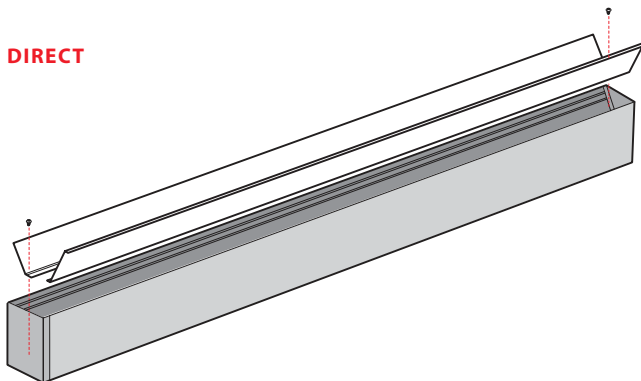

INDIRECT

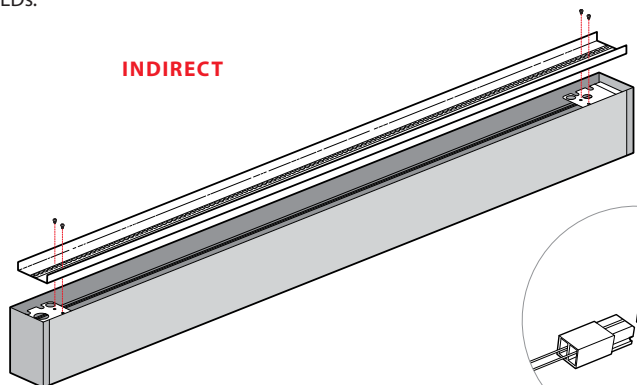

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.





BionicPro | Linear Cable Hung

INSTALLATION INSTRUCTIONS




PRUDENTIAL LTG.


PRULITE.COM 213.746.0360

2) Remove appropriate tab / knock out for power feed connection based on installation.


BPRO2 TAB REMOVED AT FACTORY

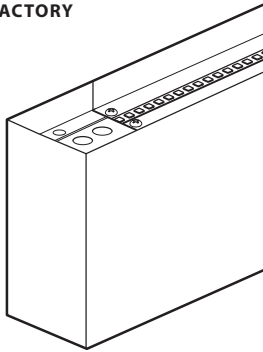

BPRO3 TAB REMOVAL

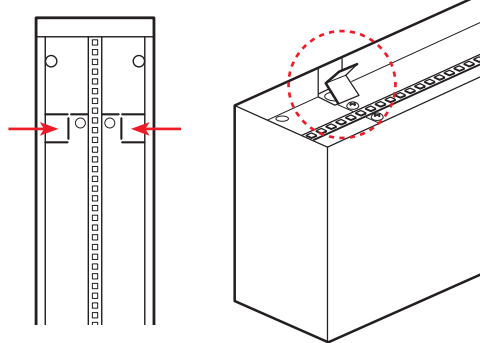


BPRO4/BPRO5 KNOCK OUT REMOVAL

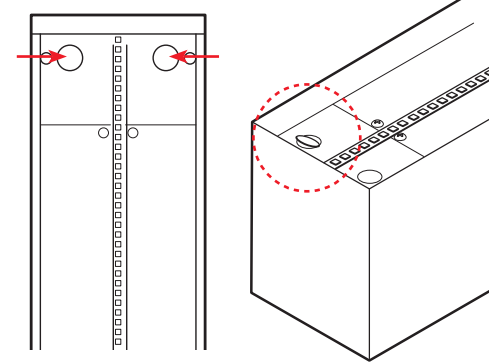


3) Install Griplock 'Y' toggle cables to hang fixtures.

DIRECT

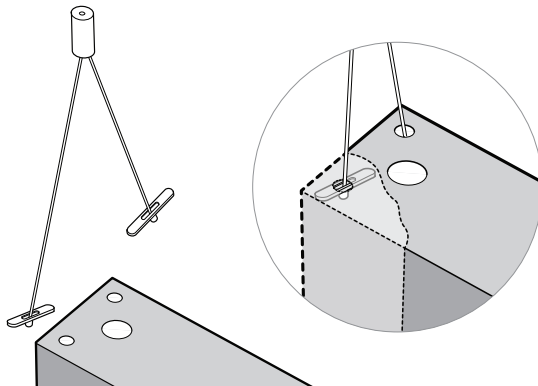


INDIRECT

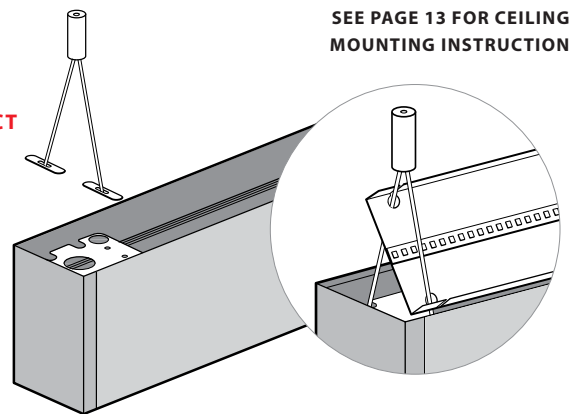


SEE PAGE 13 FOR CEILING
MOUNTING INSTRUCTION

4) Hang **START** fixtures with Griplock 'Y' cables.

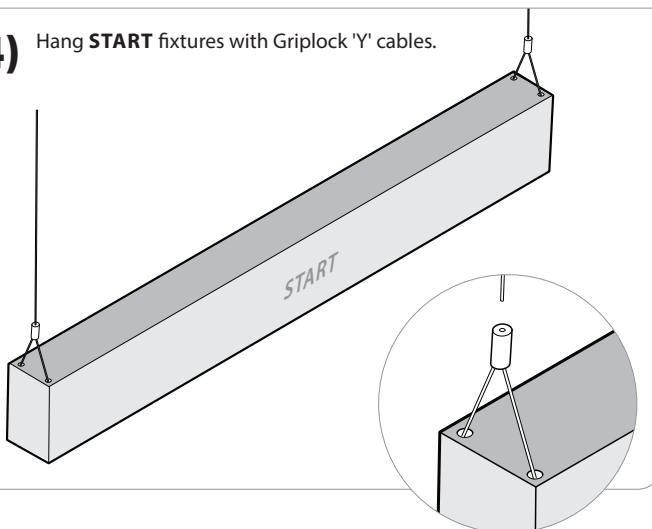

5) Insert bushing and feed cord. Crimp cord (fixture side). Cut and strip connector. Make all wiring connections (see table).

0-10V (+) : Purple	0-10V (-) : Grey
DALI (+) : Purple	DALI (-) : GREY
EcoSystem DALI (+) : Purple	EcoSystem DALI (-) : GREY
HOT : BLACK	
NEUTRAL : WHITE	
GROUND : GREEN	
CONSTANT HOT (EM) : Red	

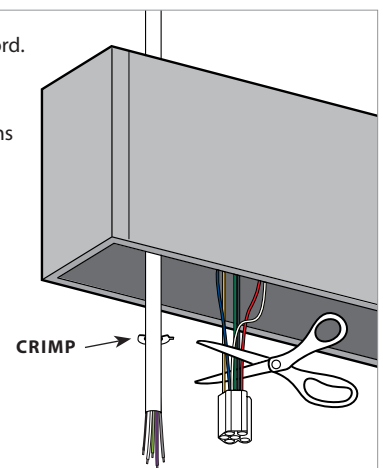

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



BionicPro | Linear Cable Hung


INSTALLATION INSTRUCTIONS




PRUDENTIAL LTG.

PRULITE.COM 213.746.0360


- 6)** Reinstall the reflector without LEDs. Make electrical connections to LEDs (See inset). Tuck all loose wires behind reflector without LEDs. Reinstall reflector with LEDs.

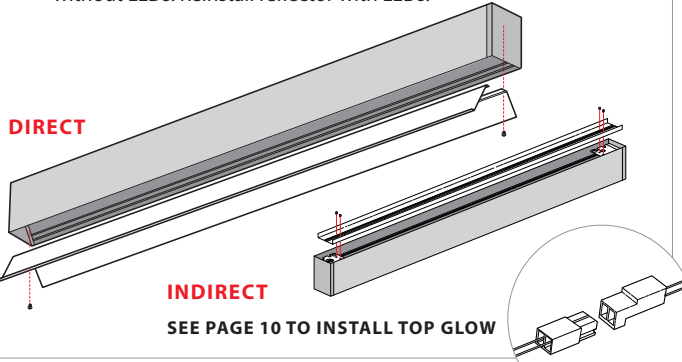

- 7)** Snap reflectors into place.

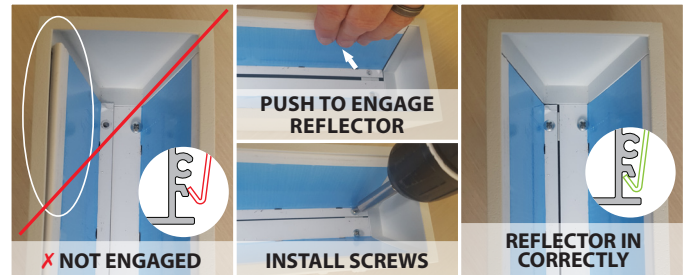

- 8)** Peel blue protective covering off reflectors.

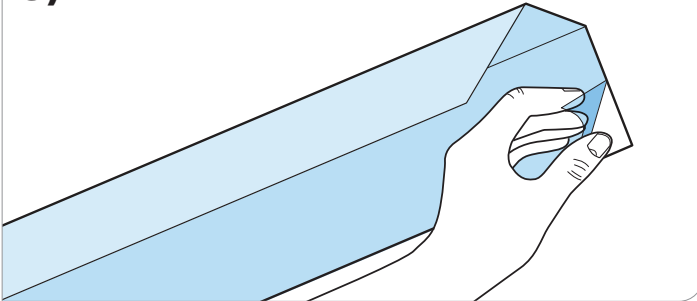

- 9)** Install Lens (See page 8).

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



BionicPro | Linear

Cable Hung

INSTALLATION INSTRUCTIONS



PRUDENTIAL LTG.


PRULITE.COM 213.746.0360

X1, X3, X6 — ROWS



⚠ DO NOT BUILD ROWS ON FLOOR TO HOIST **👤👤 REQUIRES TWO PEOPLE TO INSTALL** **CORD IS SHIPPED IN BULK**

1) Remove screws and reflectors from all fixtures and disconnect wires for LEDs.

DIRECT

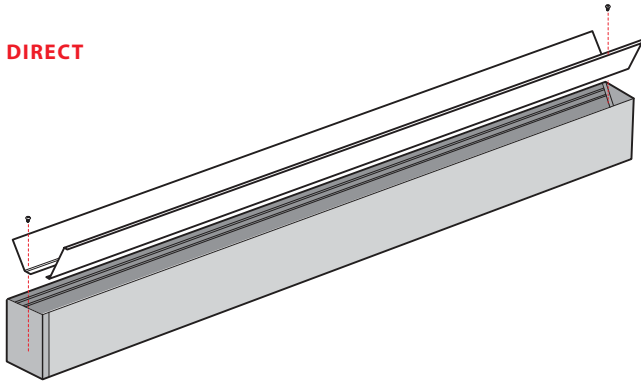


INDIRECT

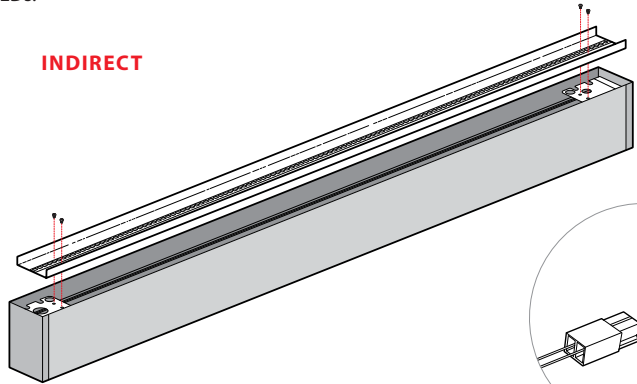


2) Remove appropriate tab / knock out for power feed connection based on installation.


**BPRO2 TAB REMOVED
AT FACTORY**

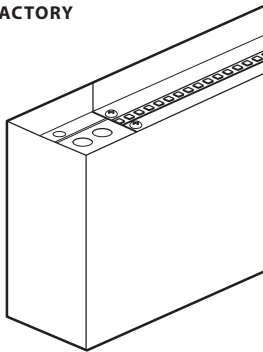

BPRO3 TAB REMOVAL

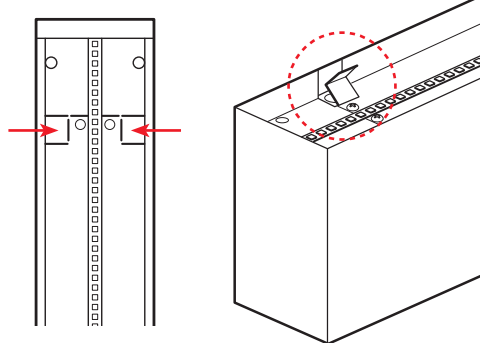


BPRO4/BPRO5 KNOCK OUT REMOVAL

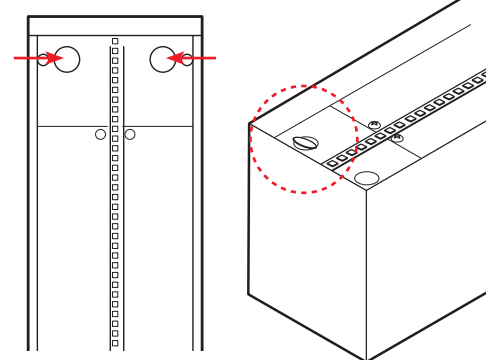


3) Install Griplock 'Y' toggle cables to hang fixtures.

DIRECT

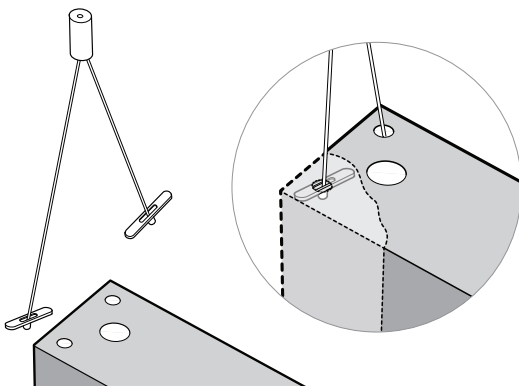

INDIRECT

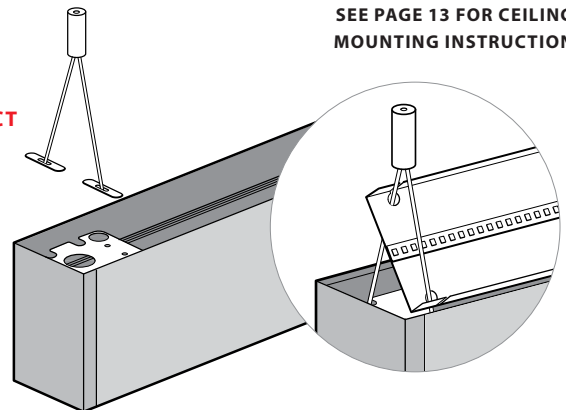

**SEE PAGE 13 FOR CEILING
MOUNTING INSTRUCTION**

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



BionicPro | Linear Cable Hung

INSTALLATION INSTRUCTIONS




PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

X1, X3, X6 — ROWS


4) Hang **START** fixtures with Griplock 'Y' cables.

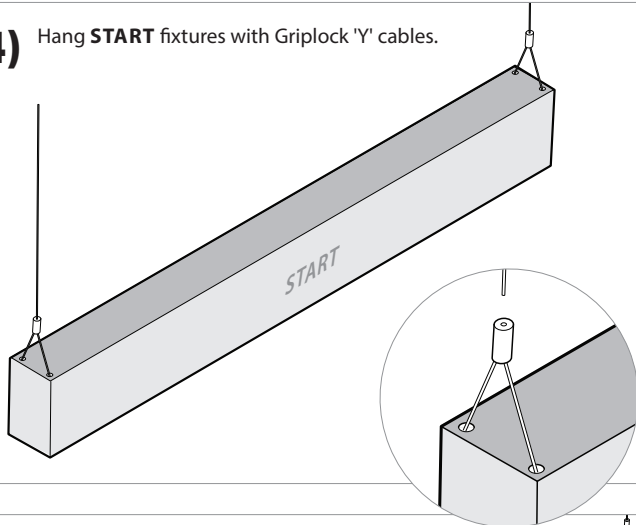


5) Insert bushing and feed cord. Crimp cord (fixture side). Cut and strip connector. Make all wiring connections (see table).

WIRING:



0-10V (+) : Purple	0-10V (-) : Grey
DALI (+) : Purple	DALI (-) : GREY
EcoSystem DALI (+) : Purple	EcoSystem DALI (-) : GREY
HOT : BLACK	
NEUTRAL : WHITE	
GROUND : GREEN	
CONSTANT HOT (EM) : Red	

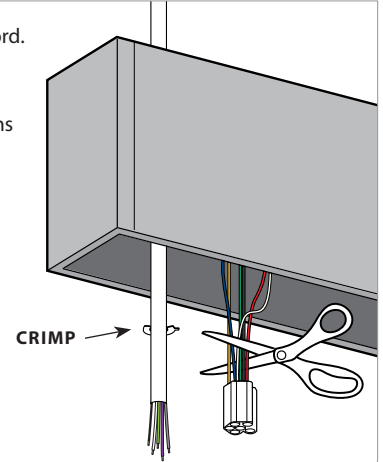


6) Hang **NEXT** fixture with one (1x) cable assembly.

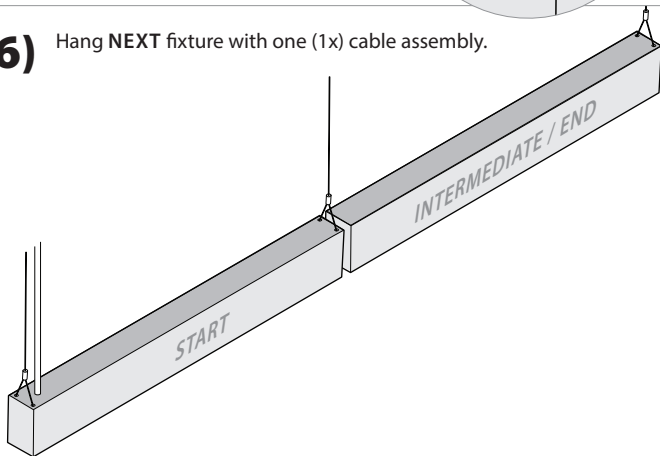

7a) Make sure taper pins are aligned.

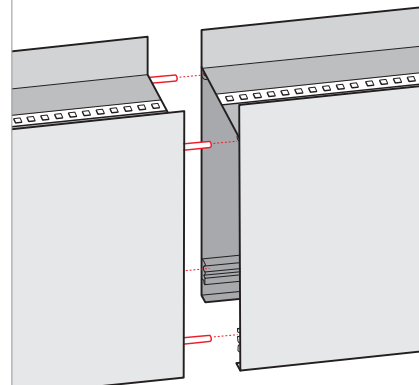


Install Bolt & Nut to both sides until snug




BPRO2: 1x BOLT

7b) Make electrical and dimming harness connections.

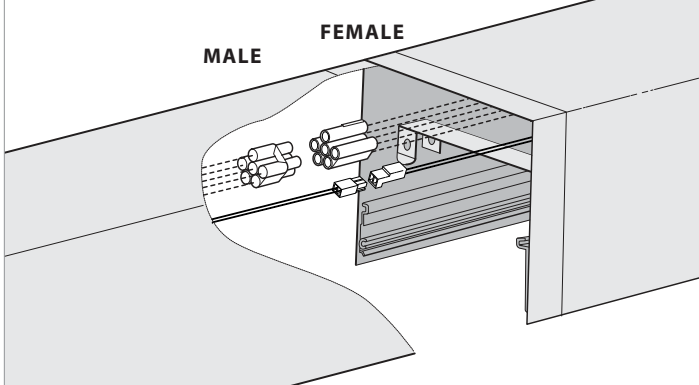

8a) Reinstall the reflector without LEDs. Make electrical connections to LEDs (See inset). Tuck all loose wires behind reflector without LEDs. Reinstall reflector with LEDs.

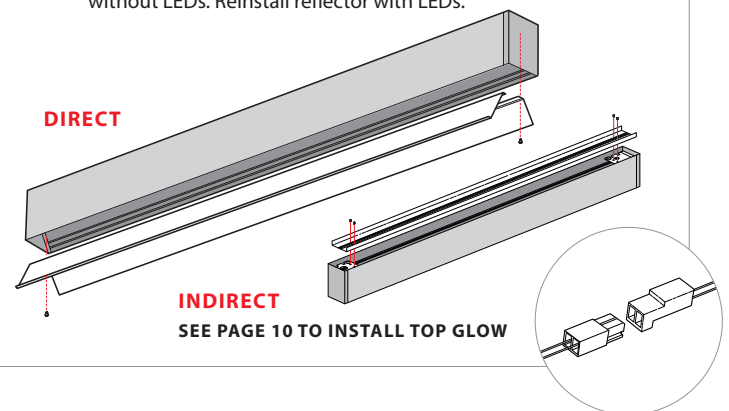

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



BionicPro | Linear Cable Hung


INSTALLATION INSTRUCTIONS




PRUDENTIAL LTG.

PRULITE.COM 213.746.0360


8b) Snap reflectors into place.

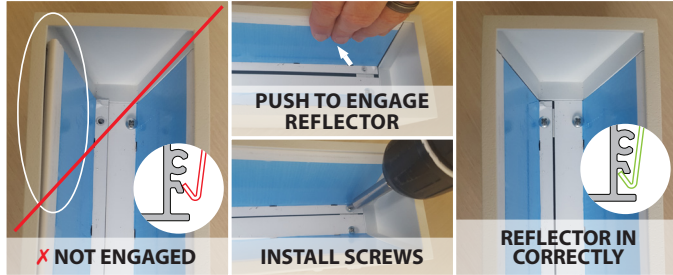


9) Peel blue protective covering off reflectors.

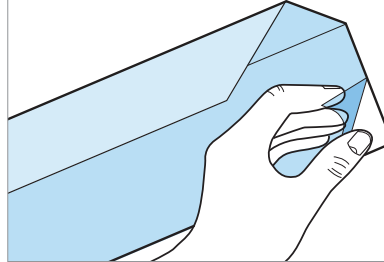


10a) Tear seam reflector at perforation. Peel film to reveal adhesive.

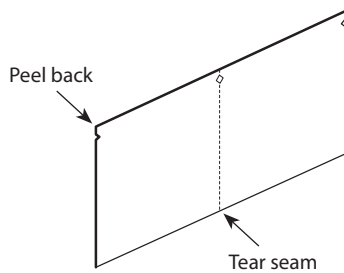


10b) Insert seam reflector under brake.

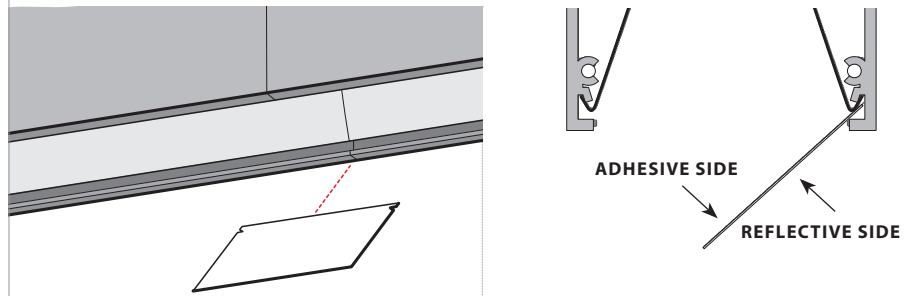


10c) Secure the seam reflector.

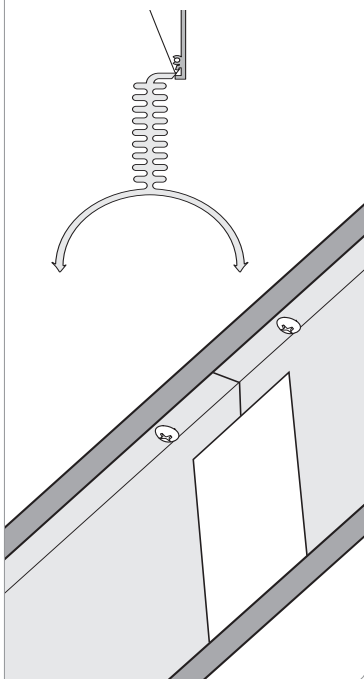


11)



**FOLD END REFLECTORS
AT PERFORATIONS**

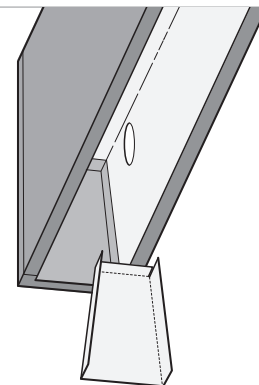

Align folded reflector with
end cap interior.

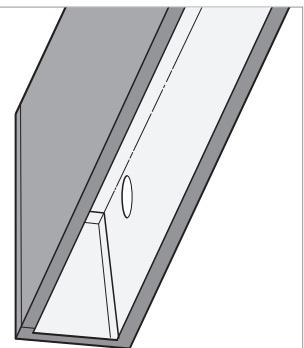

Install end reflector so it
covers the seam between the
end cap and reflector

12) Install Lens (see page 8).

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.




Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved - All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



LENS INSTALLATION

⚠ ENERGIZE ROWS TO ENSURE ALL LEDS ARE WORKING BEFORE INSTALL **👤 LENS REQUIRES TWO PEOPLE TO INSTALL**

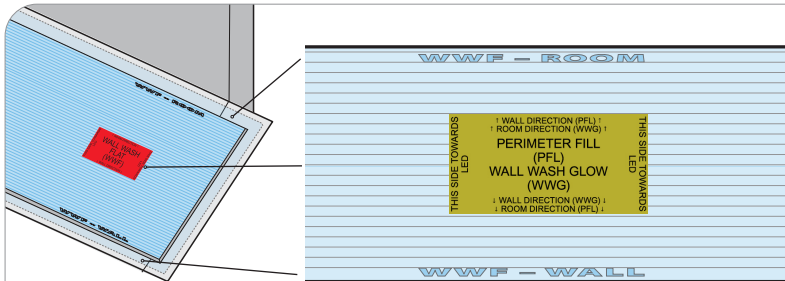

LENS ORIENTATION

SAL – Satin lens has both sides the same, reversible, no orientation

BTW – Batwing shiny side UP, matte frosted side DOWN.

MGZ/WWF/WWG/PFL – Wall Wash and Perimeter lenses, ribbed side UP (they can be seen and felt).

NOTE: WWG and PFL are the same with opposite orientation


Stickers indicate **WALL** and **ROOM** sides, but the lens also has engraving indicating each as shown.

RECOMMENDED: Start lens installation from **LEFT** to **RIGHT**.




LENS INSTALLATION — IF ALL FIXTURES ARE ALREADY INSTALLED


- 1)** Measure 18" from end cap. Using a pencil, place a small mark on the fixture.

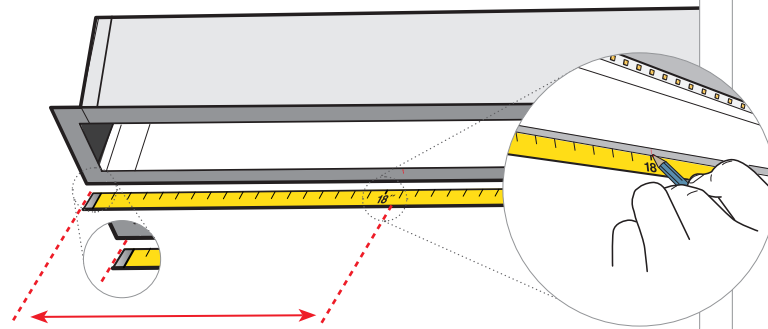


- 2)** Make sure lens is square.

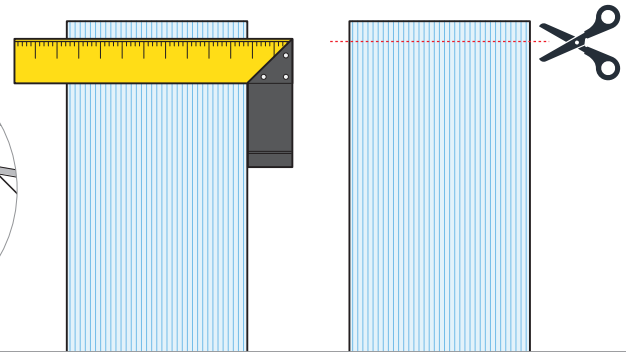

- 3)** Install tape strip **TIGHTLY** approximately 16" from start.

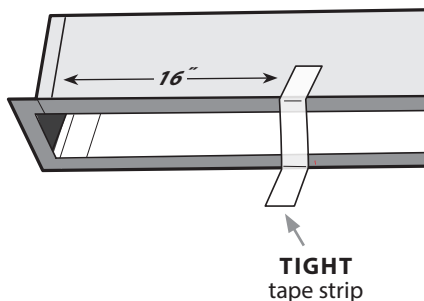


- 4)** Insert lens into lens tool, then place just before **TIGHT** tape strip.

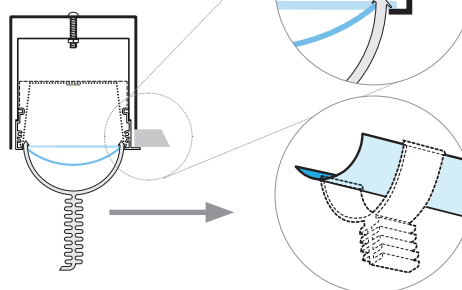

FOR BPRO2-REG3

Install clamp before inserting into fixture. Once installed in fixture, remove clamp and proceed to step 5.

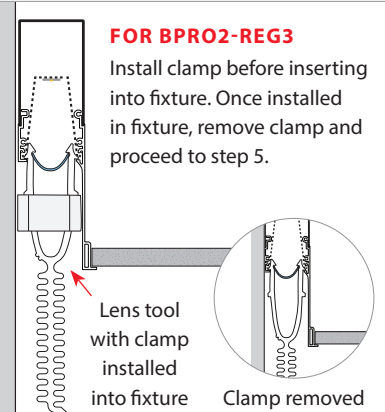

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.






INSTALLATION INSTRUCTIONS

5)


Install **LOOSE** tape strip about 12" from start to hold lens parallel to fixture (easier to pull).

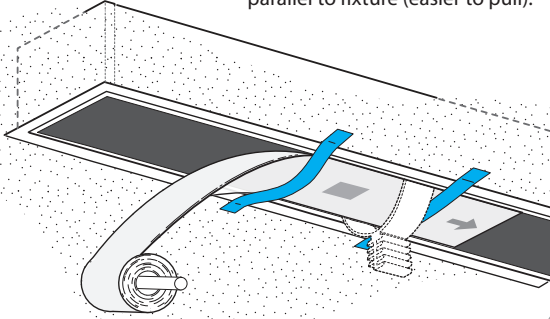

6)


Pull lens through channel with fingers or non-marring pliers.

NOTE: Hold lens roll near ceiling, close to horizontal with fixture.

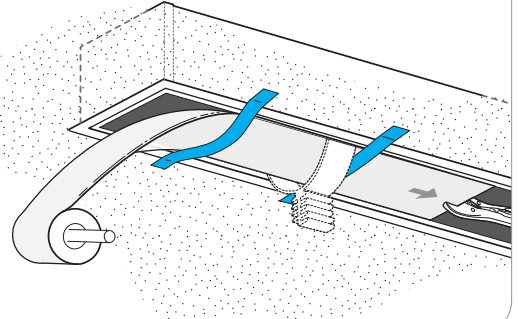

7)


Use tape strip to pull lens into end cap.

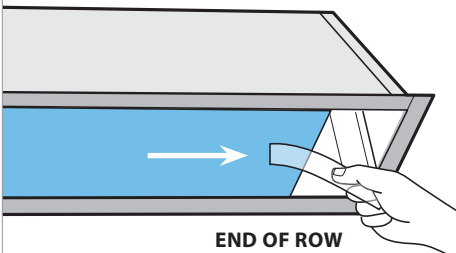

END OF ROW

8)

Make sure lens is tucked inside end cap.

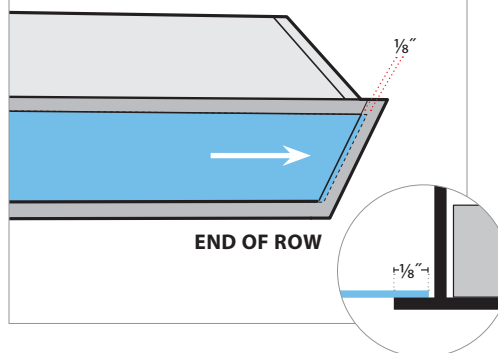


END OF ROW

9)

At start of fixture, remove tape strips and as a rough cut trim lens 1" past end cap.




MAKE SURE LENS IS TUCKED INTO END CAP AT END OF ROW AS SHOWN IN STEP 8

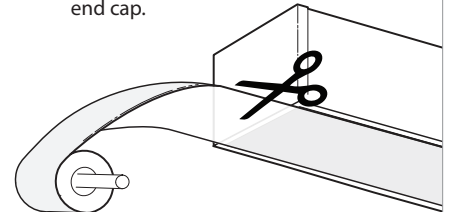

10)

Mark lens with pencil where you made the mark 18" from start of row inside fixture.

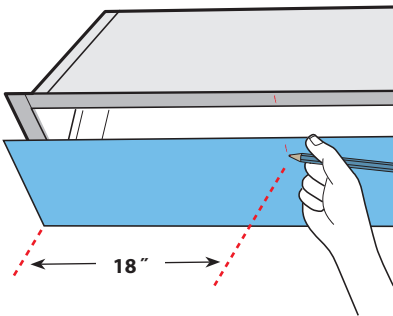


18"



MAKE SURE LENS IS TUCKED INTO END CAP AT END OF ROW AS SHOWN IN STEP 8

11)



Measure 18 1/16" from mark on lens to near end of lens. Mark and trim lens.

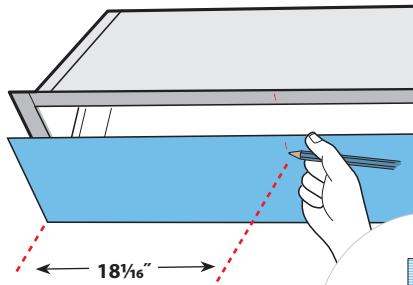

18 1/16"

12)

Slide lens tool end cap to insert remaining lens, using other end of tool or fingers to insert at end cap.

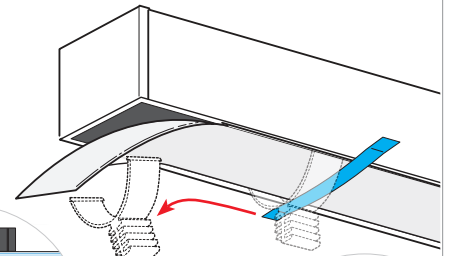


WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.







DUST COVER

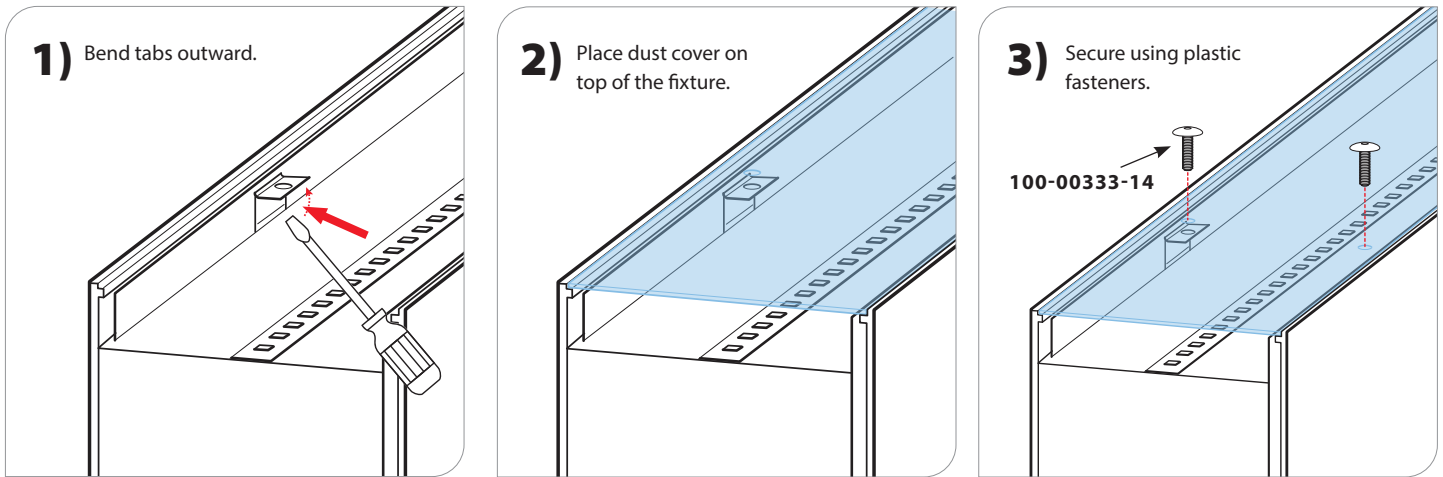

INDIRECT OPTIC

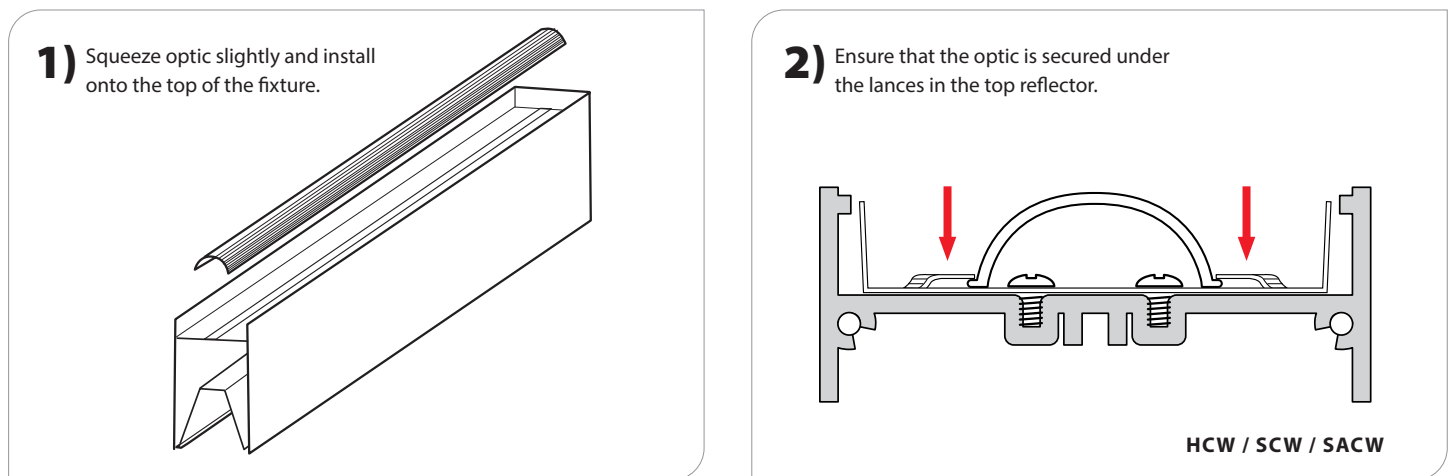

LOUVERS

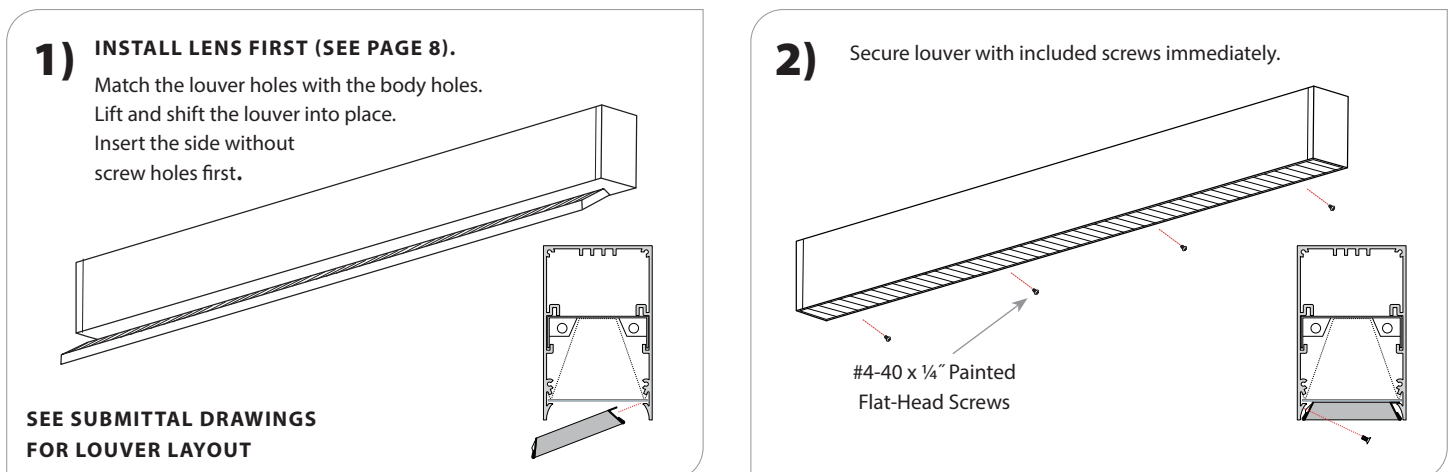

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.





BionicPro | Linear Cable Hung

INSTALLATION INSTRUCTIONS




PRUDENTIAL LTG.


PRULITE.COM 213.746.0360

TOP GLOW — INDIRECT ONLY


- 1)** Install 1 of the top glow profiles.

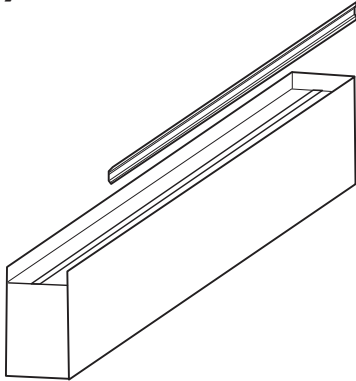


- 2)** Place the top reflector and LED assembly onto the fixture.

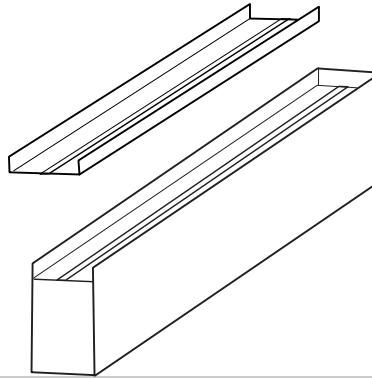


- 3)** Slide the top reflector and LED assembly to the side to allow clearance for the other top glow profile.

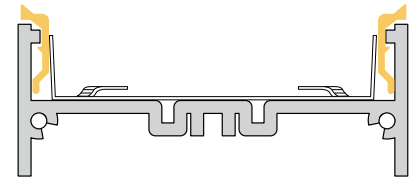


- 4)** Install the other top glow profile.

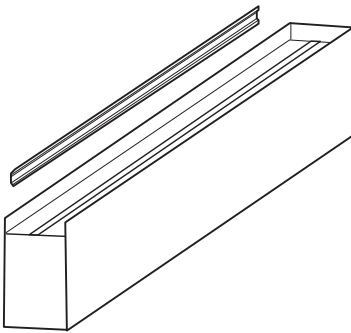


- 5)** Center the top reflector and LED assembly to secure the top glow profiles.

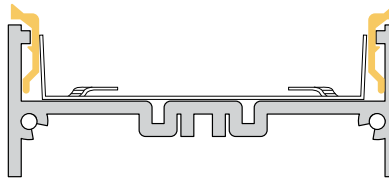

- 6)** Fasten the top reflector and LED assembly to the fixture using the included #6-32 screws.

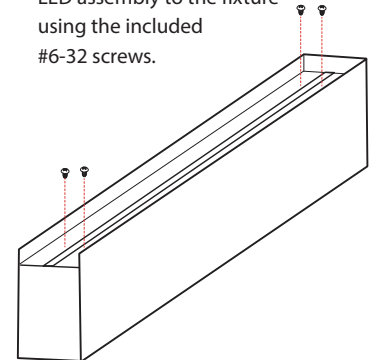

LRT (LINEAR TO RECESSED) DETAIL

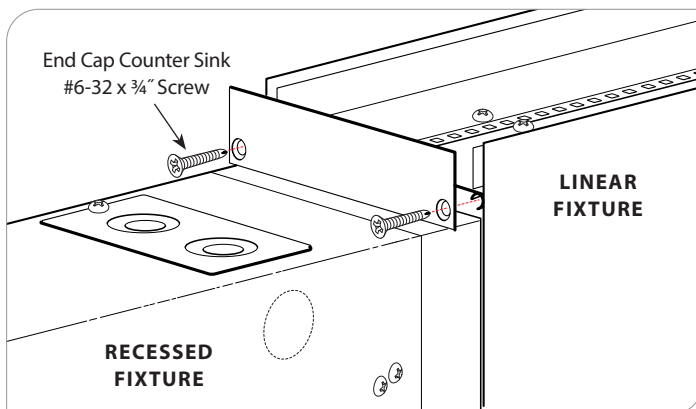

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058




FTR END OF ROW FEATHERING

STANDARD FIXTURES

Before installing lens, replace the 1/4" screws at locations **A** and **B** with 1/2" screws, placing the provided spacer under the screws as shown.


With screws and spacers installed, snap the FTR Diffuser over the LEDs at locations **A** and **B**, making sure that the hooks in the diffuser catch on the lip of the spacers. Push the FTR diffuser against the fixture endplate and install lens.

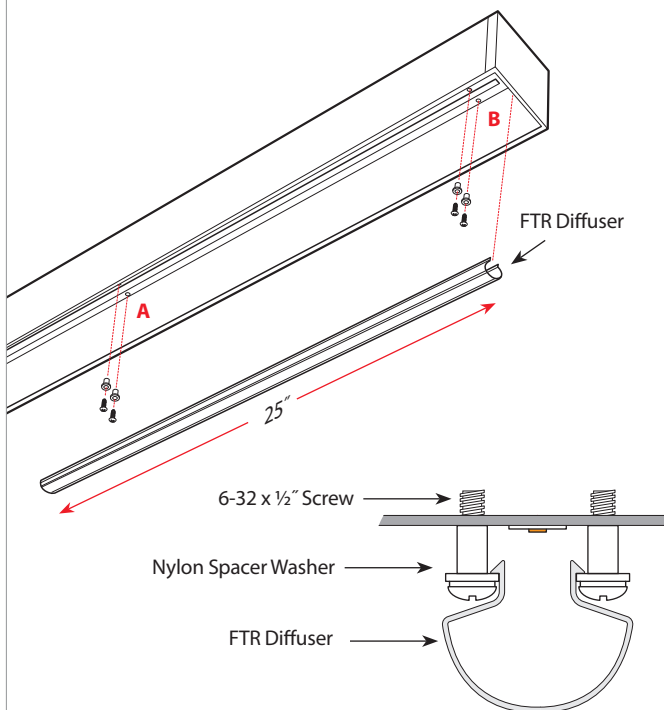

FILLER FIXTURES

After cutting the filler body to the desired length, at location **A**, replace the 1/4" screws with 1/2" screws, placing the provided spacer under the screws as shown. At location **B**, use available holes in tele-plate to attach screws and spacers.

With screws and spacers installed, snap the FTR Diffuser over the LEDs at locations **A** and **B**, making sure that the hooks in the diffuser catch on the lip of the spacers. Push the FTR diffuser against the fixture endplate and replace lens.

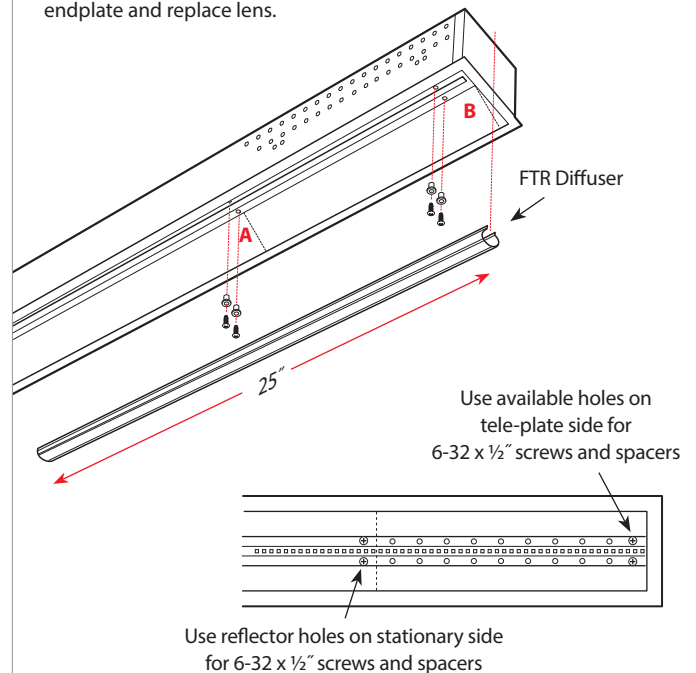

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.







ACCESSORY PLATE & SENSOR INSTALLATION

SENSORS


Iota Light/Switch

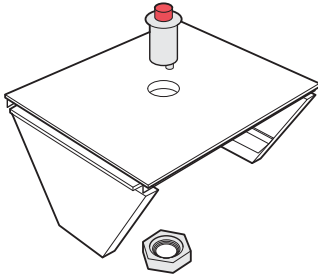

Enlighted Micro Sensor

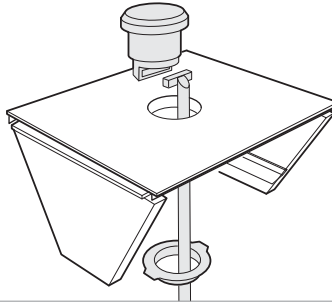


Acuity nLight

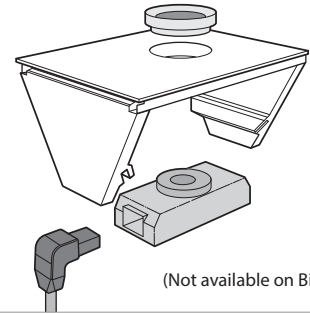


(Not available on BioPro2)


Wattstopper FS-205

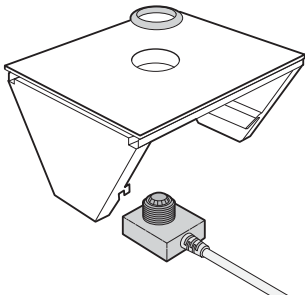

Lutron Vive




Hubbell NXRM-H



(Not available on BioPro2)

Hubbell NXSMP-SMI




WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.








ACCESSORY PLATE ASSEMBLY




Insert slider spring tabs into dovetail slots in the bottom of plate

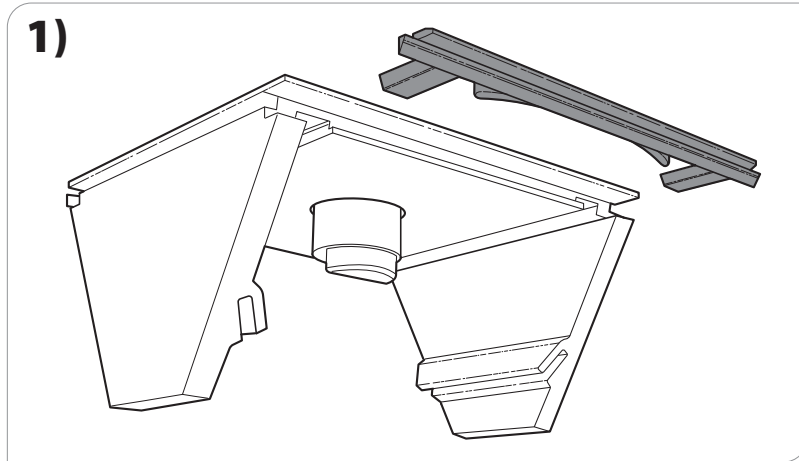

Spring tabs must be oriented to match dovetails in plate

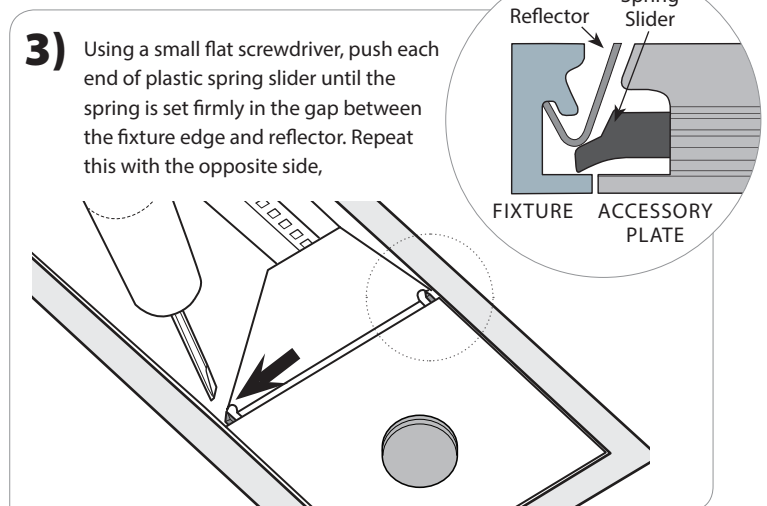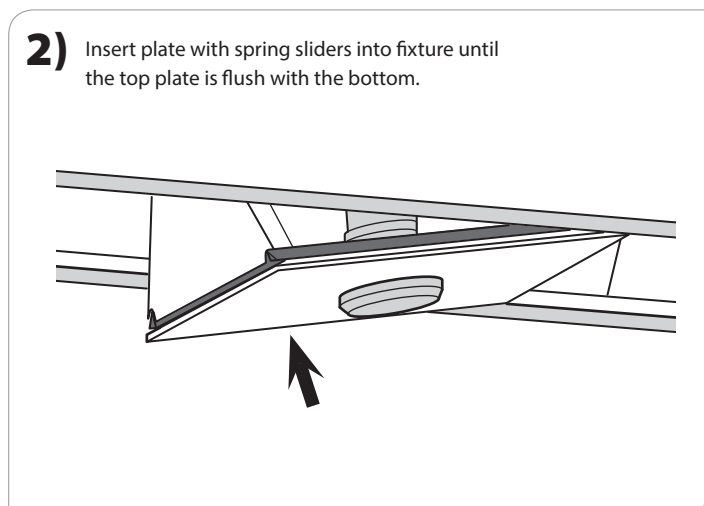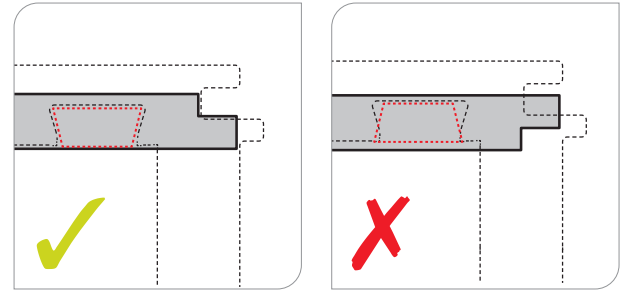

ACCESSORY PLATE REMOVAL

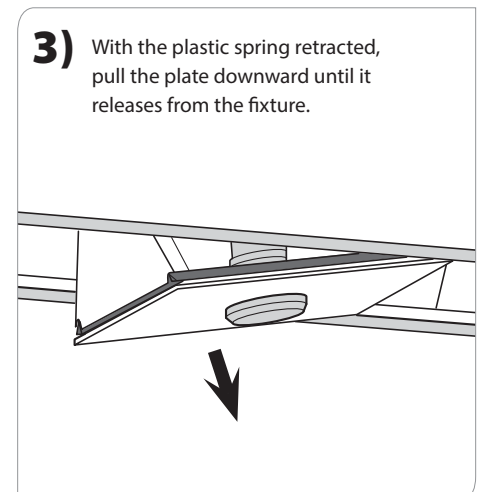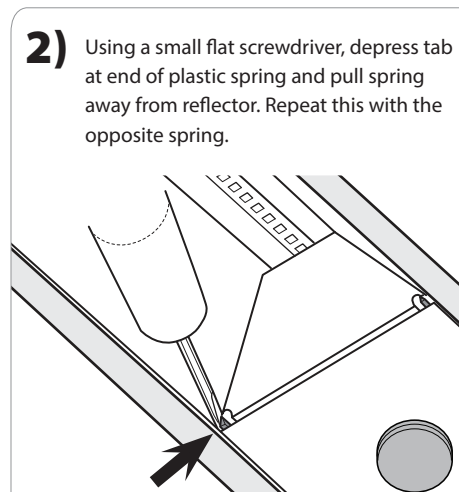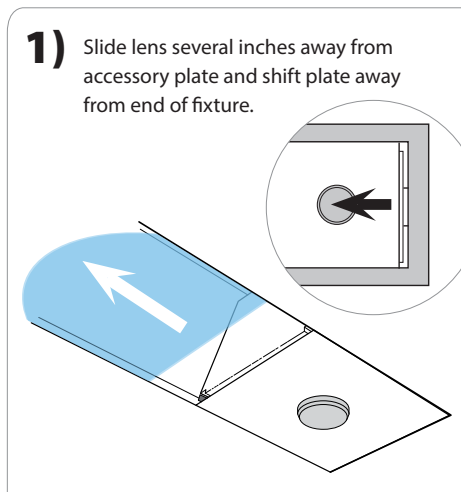

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.





BionicPro | Linear

Adjustable Toggle Cable (X1 / T-Bar)

INSTALLATION INSTRUCTIONS




PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

1. Place ¼-20 stud into square opening on the bottom of I.D.S. clip. Position I.D.S. clip on ceiling grid at required location. Secure clip to structural member by inserting support wire through ¼" dia. hole located at top of I.D.S. clip (wire provided by others).
2. Insert open end of support cable through top threaded end of ¼-20 coupling. Pull cable until crimp stops inside threaded end of coupling.
3. Push open (non crimped) end of cable through top (smooth end of adjustable glider). Insert cable completely through glider. Glider will engage around cable to prevent slipping. Disengage glider by pressing top smooth end down. Hold in place and pull cable back for adjustment.
4. Insert toggle cable through ⅝" holes on each side of fixture housing, adjust cable to desired lengths. Trim excess cable no less than 3" beyond cable outlet.
5. Unscrew threaded ring from top of ¼-20 coupling. Insert ¼-20 coupling through ⅜" dia. center hole on canopy and let threaded ring and canopy rest on fixture end. Lift coupling/cable to ceiling with fixture attached and thread ¼-20 coupler onto strap bolt (be sure coupling is secure). Adjust cable to required distance from ceiling surface. Lift canopy against ceiling surface and secure in place with threaded ring.

CAUTION: Do not remove crimp from cable. Crimps are factory pressed onto cable for maximum strength. **Prudential Lighting will not be responsible for damage or injuries which occur due to cable/crimp alterations.** If different cable lengths are required, contact Prudential Lighting immediately.

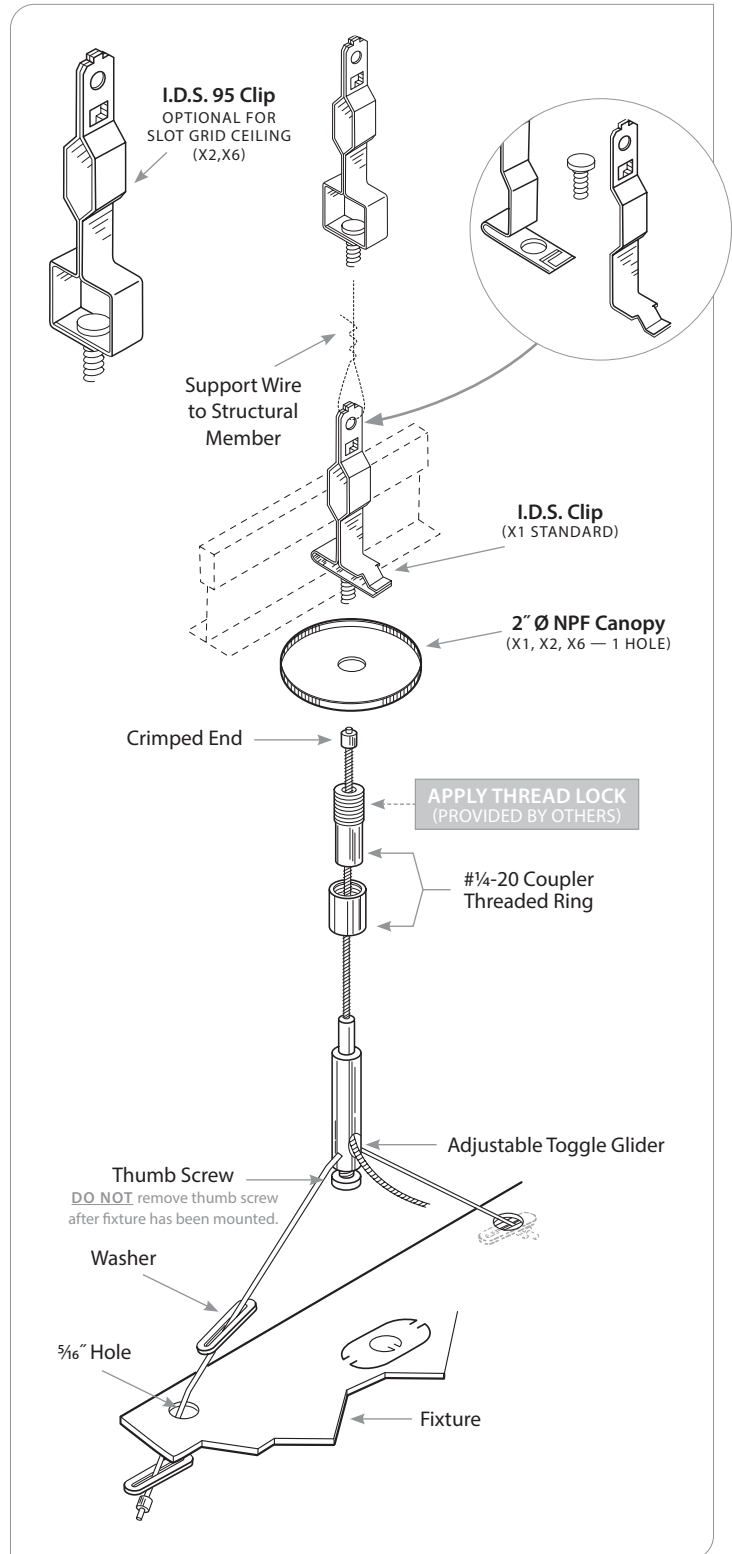

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved - All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



BionicPro | Linear

Adjustable Cord / Cable Support (X1 / T-Bar)

INSTALLATION INSTRUCTIONS



PRUDENTIAL LTG.


PRULITE.COM 213.746.0360

1. Place 1/4-20 stud into square opening on the bottom of I.D.S. clip. Position I.D.S. clip on ceiling grid at required location. Place A.T. Clip onto ceiling grid. Slide A.T. clip against I.D.S. clip. Attach 3 1/2" octagonal electrical box to A.T. clip with 1/4-20 x 3/4" screw. Place washers between A.T. clip and electrical box. Secure box to grid. (See figure 1).
2. Insert open end of support cable through top threaded end of 1/4-20 coupler. Pull cable until crimp stops inside threaded end of coupler. Push (Non-crimped end) of cable through top (smooth end of adjustable glider). Insert cable completely through glider. Hold in place and pull cable for adjustment.
3. Insert toggle cable through 5/16" holes on each side of fixture housing, adjust cable to desired lengths. Trim excess cable no less than 3" beyond cable outlet.
4. Remove 1/2" round K.O. from the fixture. *Contractor to field cut SJT cord at specified lengths and strip back a portion of outer insulation from one end of SJT cord. (Contractor to determine amount to be stripped). Insert stripped end of SJT cord through snap bushing. Press snap bushing and cord through 1/2" hole of the fixture. The cord should be secured with strain relief inside fixture.
5. Place threaded ring over top of 1/4-20 coupler. Insert 1/4-20 coupler through 1 3/32" dia. center hole on canopy. Slip universal bushing and threaded bushing over top end of SJT cord. Let canopy rest on fixture end. Lift coupler/cable to ceiling with fixture attached. Thread 1/4-20 coupler onto I.D.S. stud. (Be sure coupler is secure). Adjust cable to require distance from ceiling surface.
6. Use 1/2" nipple from canopy to electrical box. Trim SJT cord to required length and secure to electrical box with strain relief. Make all wire connections and replace electrical box cover. Lift canopy against ceiling surface. Apply a small amount of thread lock to coupler threaded area. Secure in place with threaded ring. Hold SJT cord under canopy and turn threaded bushing onto 1/2" nipple. Snap universal bushing into threaded bushing.

NOTE: Canopy will accommodate 3 1/2" octagonal electrical box. Electrical box must be attached to A.T. clip. Refer to NEC 370-16 for maximum electrical box fill. Clamp connector and electrical box provided by others.

CAUTION: Do not remove crimp from cable. Crimps are factory pressed onto cable for maximum strength. Prudential Lighting will not be responsible for damage or injuries which occur due to cable/crimp alterations. If different cable lengths are required, contact Prudential Lighting immediately.

* Cord must terminate directly into electrical box. Cord is not plenum rated. 1" of additional cord provided for each feed location.

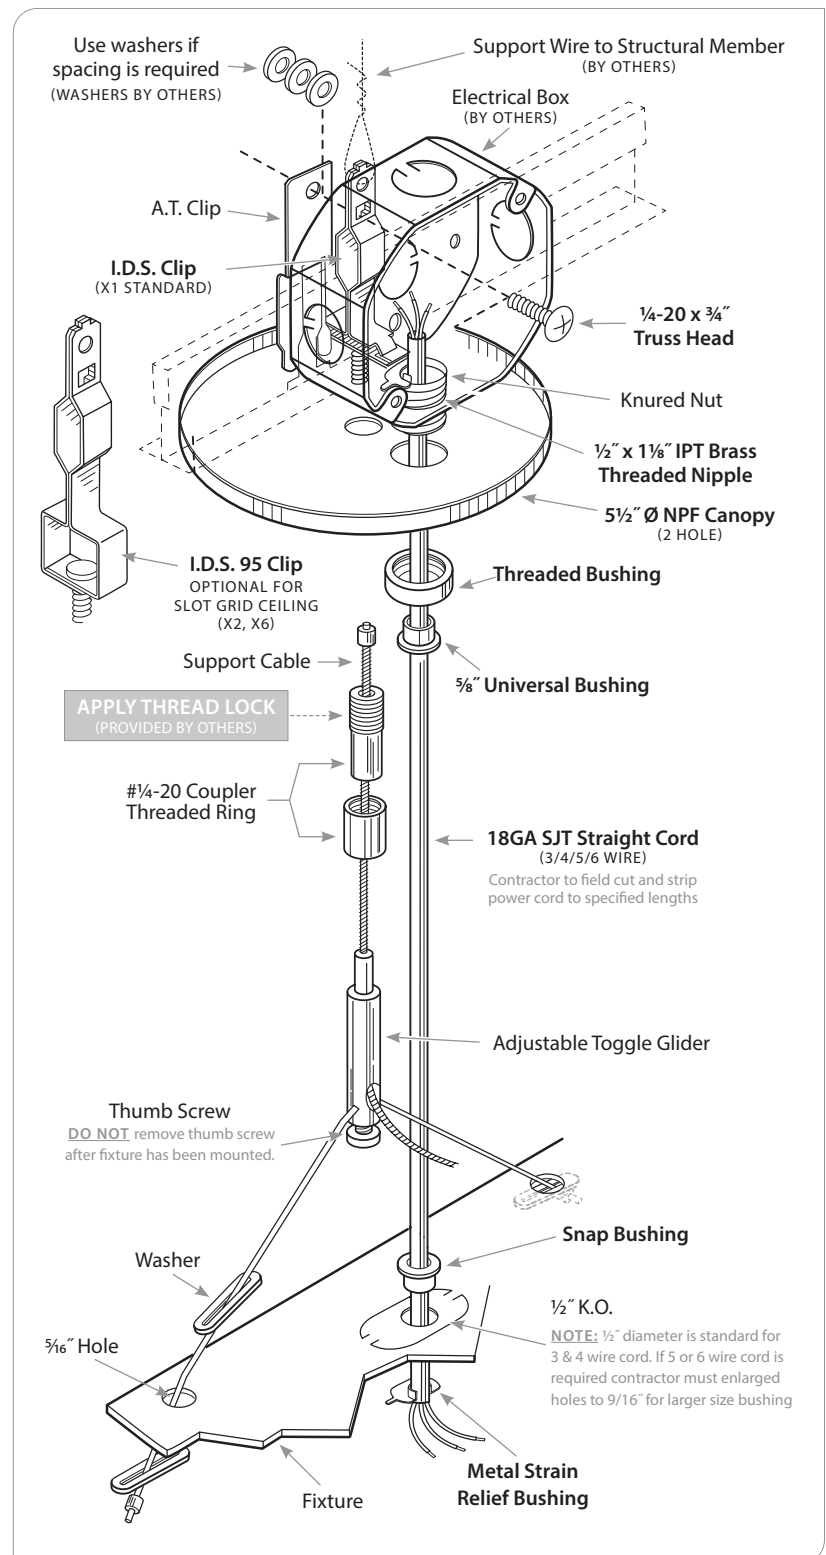

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved - All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058

19 of 21

08-14-2023



BionicPro | Linear

Adjustable Cable Support (X3 / Hard Ceiling)

INSTALLATION INSTRUCTIONS




PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

1. Anchor mounting straps to ceiling at cable locations. If mounting plan drawings is provided follow dimensions specified in row or pattern layout. (Contractor is to determine best anchoring hardware to be used in securing mounting strap to ceiling)
2. Insert non-crimped end of support cable through top threaded end of 1/4-20 coupling. Pull cable until crimp stops inside threaded end of coupling.
3. Push non-crimped end of cable through top (smooth end adjustable glider). Insert cable completely through glider. Glider will engage by pressing top smooth end down. Hold in place and pull back for adjustment.
4. Insert toggle cable through 5/16" holes on each side of fixture housing, adjust cable to desired lengths. Trim excess cable no less than 3" beyond cable outlet.
5. Unscrew threaded ring from top of 1/4-20 coupling. Insert 1/4-20 coupling through 1 3/32" dia. center hole on canopy and let threaded ring and canopy rest on fixture end. Lift coupling/cable to ceiling with fixture attached and thread 1/4-20 coupler onto strap bolt (be sure coupling is secure). Adjust cable to required distance from ceiling surface. Lift canopy against ceiling surface and secure in place with threaded ring.

NOTE: Depending on ceiling construction, reinforcement may be required at each mounting location.

CAUTION: Do **NOT** remove crimp from cable. Crimps are factory pressed onto cable for maximum strength. Prudential Lighting will not be responsible for damage or injuries which occur due to cable/crimp alterations. If different cable lengths are required, contact Prudential Lighting immediately.

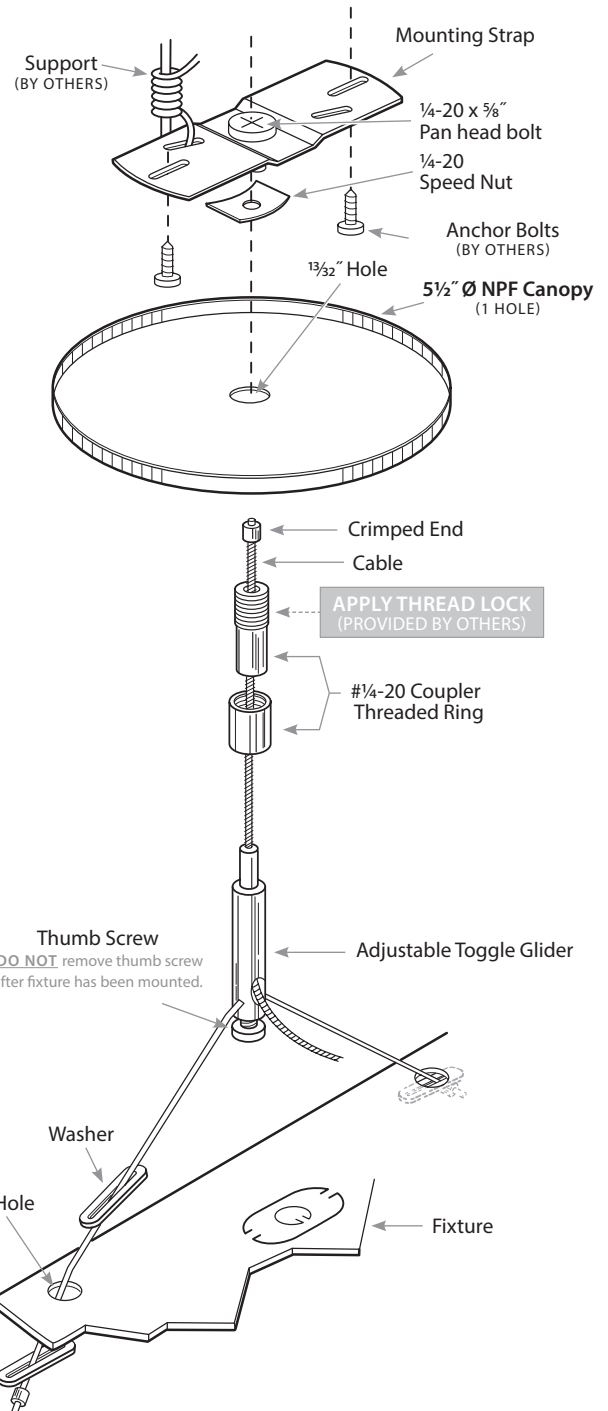

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058



BionicPro | Linear

Adjustable Cord / Cable Support (X3 / Hard Ceiling)

INSTALLATION INSTRUCTIONS




PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

1. Use #8-32 x $\frac{7}{8}$ " screws (provided by others) to fasten the mounting strap to the J-box. If weight exceeds 50 pounds, reinforce mounting strap with support wire secured to structural material (support wire provided by others).
2. Insert open end of support cable through top threaded end of $\frac{1}{4}$ -20 coupler. Pull cable until crimp stops inside threaded end of coupler. Push (Non-crimped end) of cable through top (smooth end of adjustable glider). Insert cable completely through glider. Hold in place and pull cable for adjustment.
3. Insert toggle cable through $\frac{5}{16}$ " holes on each side of fixture housing, adjust cable to desired lengths. Trim excess cable no less than 3" beyond cable outlet.
4. Remove $\frac{1}{2}$ " round K.O. located on surface of fixture end. *Contractor to field cut SJT cord at specified lengths and strip back a portion of outer insulation from one end of SJT cord (contractor to determine amount to be stripped). Insert stripped end of cord through snap bushing. Press snap bushing & cord into $\frac{1}{2}$ " round opening. Place metal strain relief bushing around cord under fixture end and crimp with pliers. Cord should be secured to fixture end. Insert top end of cord through universal bushing, and threaded bushing. Trim cord to required length and secure to canopy with strain relief through $\frac{1}{2}$ " nipple. Make all wire connection.
5. Unscrew threaded ring from top of $\frac{1}{4}$ -20 coupling. Insert $\frac{1}{4}$ -20 coupling through center hole on canopy. Apply small amount of thread lock on mounting stud. Lift coupling/canopy, and fixture to mounting strap and screw coupling to bolt (be sure coupling is secure). Adjust cable to required distance from ceiling surface.

CAUTION: Do **NOT** remove crimp from cable. Crimps are factory pressed onto cable for maximum strength. Prudential Lighting will not be responsible for damage or injuries which occur due to cable/crimp alterations. If different cable lengths are required, contact Prudential Lighting immediately.

* Cord must terminate directly into electrical box. Cord is not plenum rated. 1" of additional cord provided for each feed location.

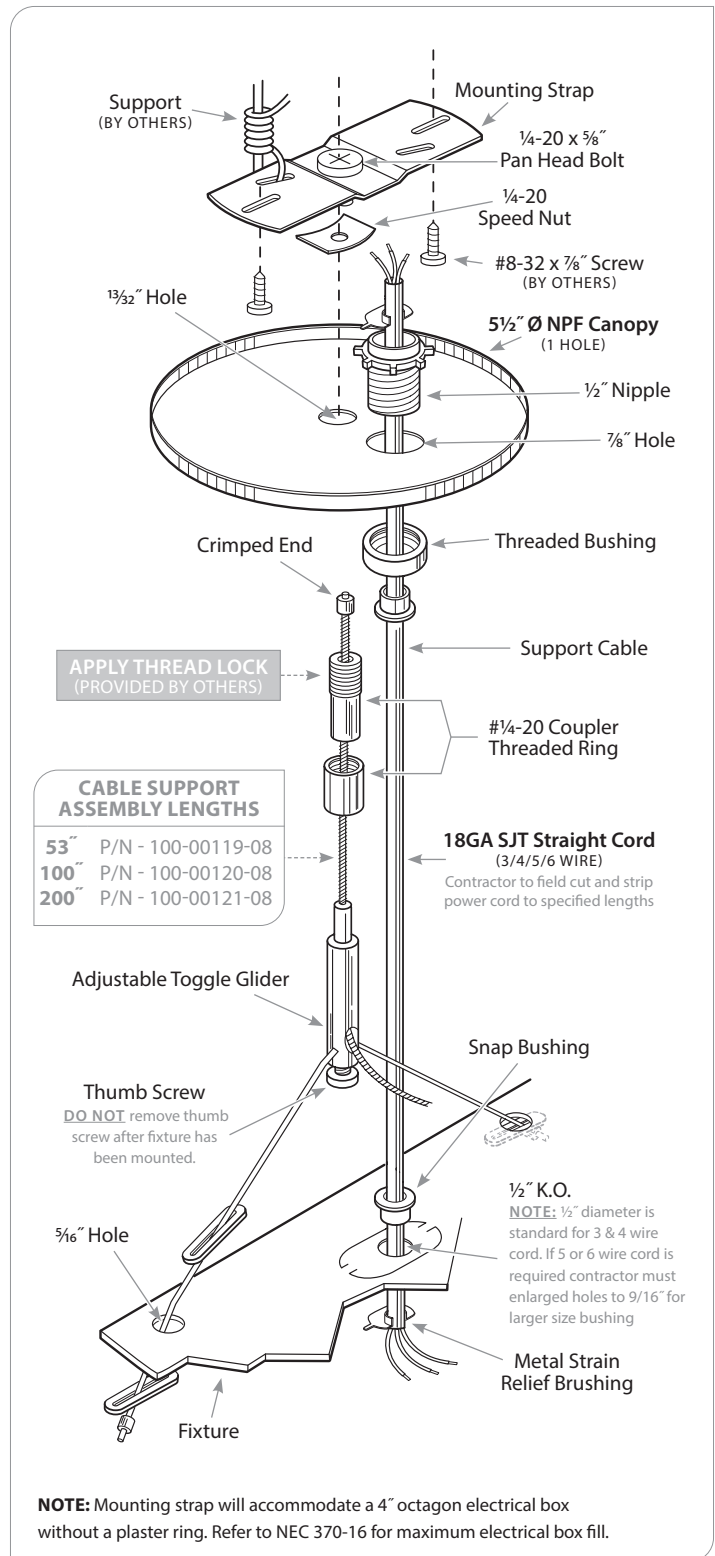

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2014 All rights reserved - All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058