

# Gaze | Round & Square

## Powered Aircraft Cable

### INSTALLATION INSTRUCTIONS



#### X1 — T-BAR — OFF-GRID / X3 — HARD CEILING



PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

**👤👤 MAY REQUIRE TWO PEOPLE TO INSTALL**


PART	PART NUMBER	DESCRIPTION	QTY
	100-00214-14	8-32 x 7/8" Phillips Pan Type F Screw (PAC R/S ONLY)	4
	100-00334-14	#6-32 x 3/8" Phillips Pan Head. Type F Screw	8

#### FIXTURE WEIGHTS:


	12"	18"	24"	36"	48"
<b>ROUND LED</b>	8lbs	17lbs	23lbs	44lbs	75lbs
<b>SQUARE LED</b>	9lbs	21lbs	28lbs	54lbs	100lbs

#### RPM / SPM CANOPIES (SHIPPED ASSEMBLED):

4 CABLES




6 CABLES




1

#### DRIVER BOXES:




— PAC R/S — Direct Canopy Mount (X3 CEILINGS ONLY)



— RPAC R/S — Remote

#### CADDY FAN-FIXTURE ASSEMBLY FOR X1 CEILINGS (BY OTHERS):

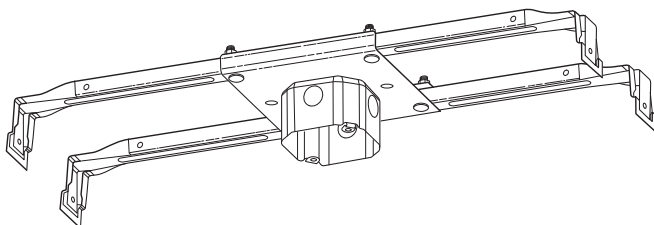

**WARNING:** Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury. Fixture Installations should ONLY be done by a qualified licensed electrical professional.



### INSTALLATION INSTRUCTIONS



## X1 — T-BAR — OFF-GRID / X3 — HARD CEILING

**👤👤 MAY REQUIRE TWO PEOPLE TO INSTALL**

### GENERAL NOTES

- If mounting to hard ceiling, it is recommended to mount driver box before drywall is installed.
- If drywall is already installed, or if install is a remodel, a large enough opening will need to be cut in ceiling to mount driver box to structure according to your installation type (See mounting options A, B, C or D).
- Mounting options A, B and C are to be installed in hard ceiling only.
- Mounting option D is to be installed in t-bar ceiling.

## 1) INSTALL DIRECT CANOPY MOUNT

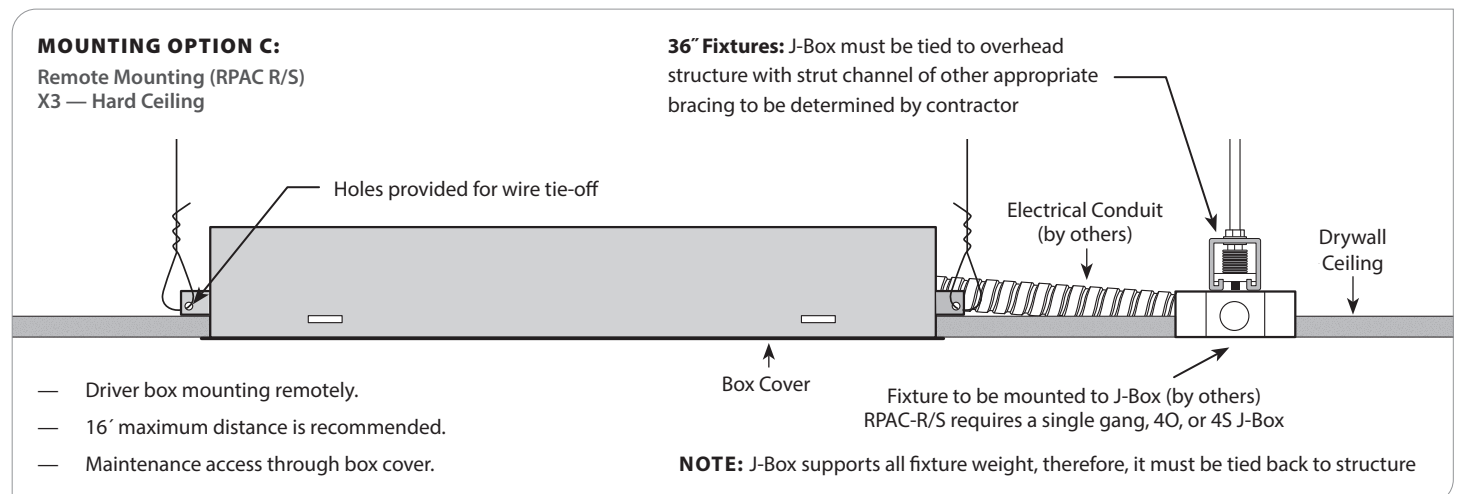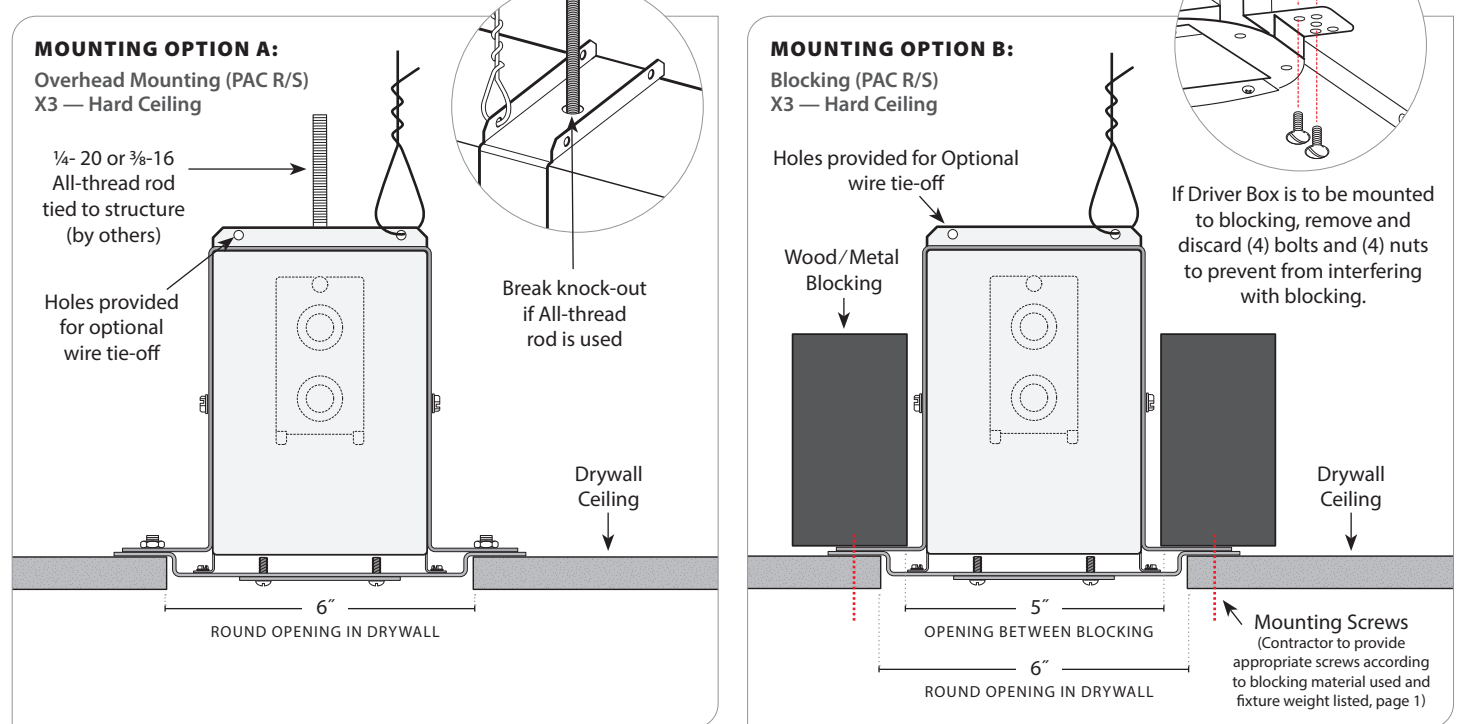

**WARNING:** Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury. Fixture Installations should ONLY be done by a qualified licensed electrical professional.




### INSTALLATION INSTRUCTIONS

## X1 — T-BAR — OFF-GRID / X3 — HARD CEILING

**👤👤 MAY REQUIRE TWO PEOPLE TO INSTALL**

### MOUNTING OPTION D:

Remote Mounting (RPAC R/S)  
X1 — T-Bar

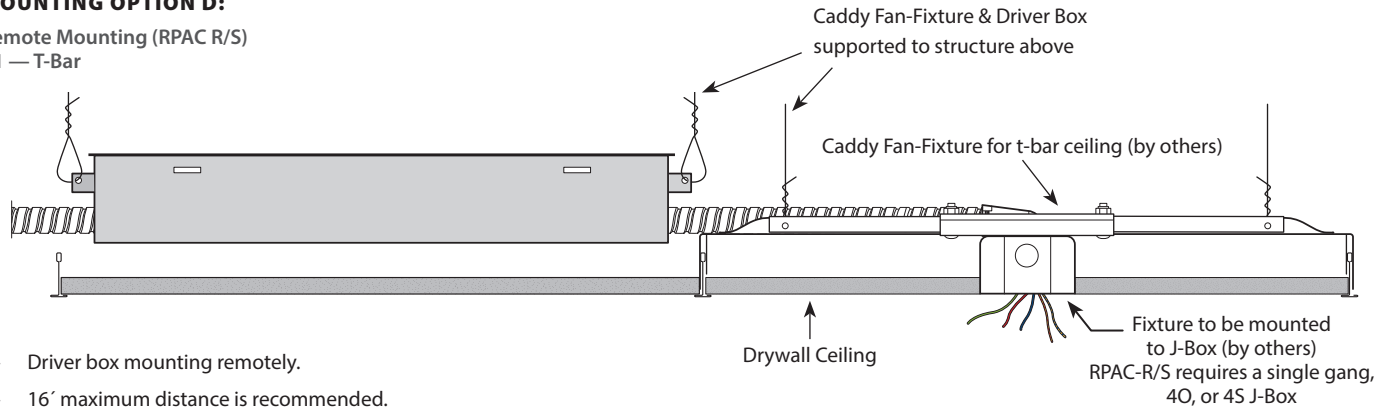


- Driver box mounting remotely.
- 16' maximum distance is recommended.
- Maintenance access through box cover.

**NOTE:** J-Box supports all fixture weight, therefore, it must be tied back to structure

## 2a) MAKE WIRING CONNECTIONS TO DRIVER BOX

### MOUNTING OPTION A & B:

X3 — Hard Ceiling

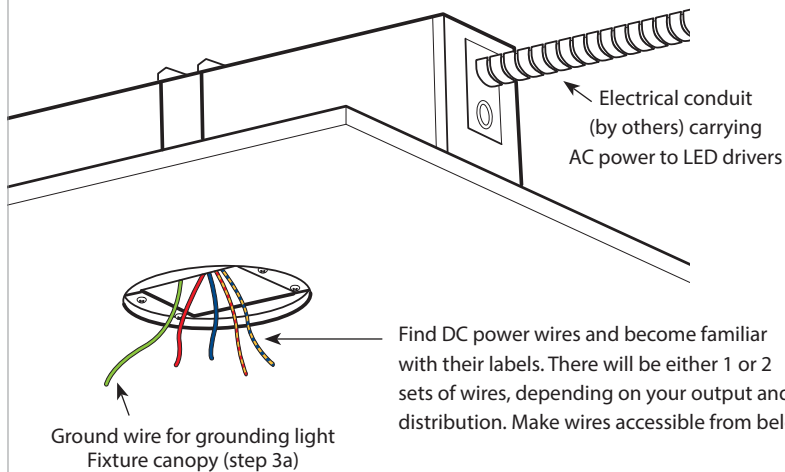

Find DC power wires and become familiar with their labels. There will be either 1 or 2 sets of wires, depending on your output and distribution. Make wires accessible from below

### WIRING:

- HOT : BLACK
- NEUTRAL : WHITE
- GROUND : GREEN
- CONSTANT HOT (EM) : RED

### DC POWER WIRES (LOW VOLTAGE):

Label	Color	Description
DIR 1 +	RED	DIRECT LIGHT DRIVER 1 POSITIVE +
DIR 1 -	BLUE	DIRECT LIGHT DRIVER 1 NEGATIVE -
DIR 2 +	YELLOW/RED	DIRECT LIGHT DRIVER 2 POSITIVE +
DIR 2 -	YELLOW/BLUE	DIRECT LIGHT DRIVER 2 NEGATIVE -
INDIR +	RED/WHITE	INDIRECT LIGHT POSITIVE +
INDIR -	BLUE/WHITE	INDIRECT LIGHT NEGATIVE -

**WARNING:** Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury. Fixture Installations should ONLY be done by a qualified licensed electrical professional.





## X1 — T-BAR — OFF-GRID / X3 — HARD CEILING

**👤👤 MAY REQUIRE TWO PEOPLE TO INSTALL**


### MOUNTING OPTION C & D:

- Route all DC power wires to J-Box located where light fixture is to be mounted.
- Some light fixtures may require multiple driver boxes. There will be a total of 1, 2, or 3 sets of wires depending on your output and distribution.
- 72" of wire will be provided. If remote distance is more than 72", additional wire will need to be provided by others. Wire labels will need to be duplicated at J-box.

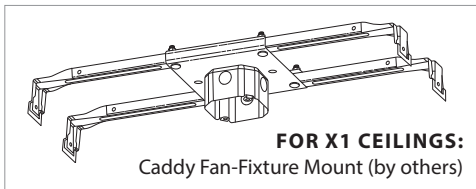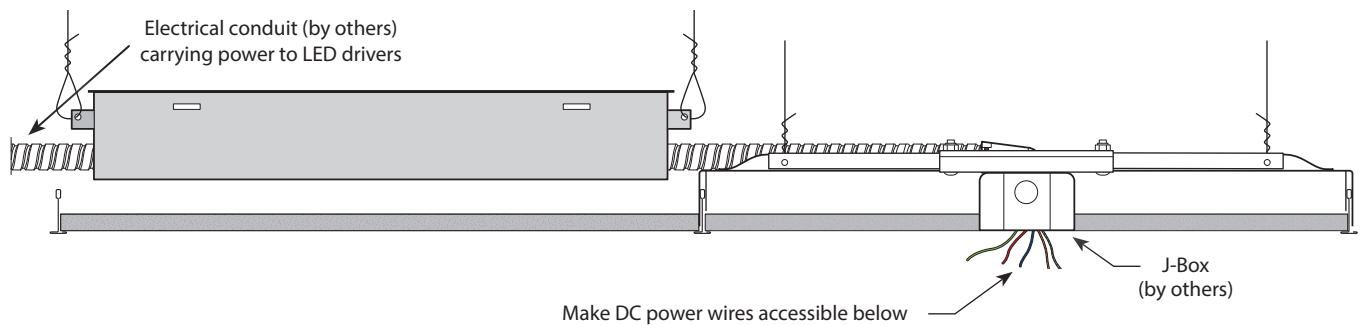

**2b)** Once AC power has been wired driver box, drywall ceiling can be installed. Now you are ready to mount light fixture.

**3)** Unscrew canopy cover and disassemble canopy. **DO NOT** remove aircraft cables from plastic insulation ring.

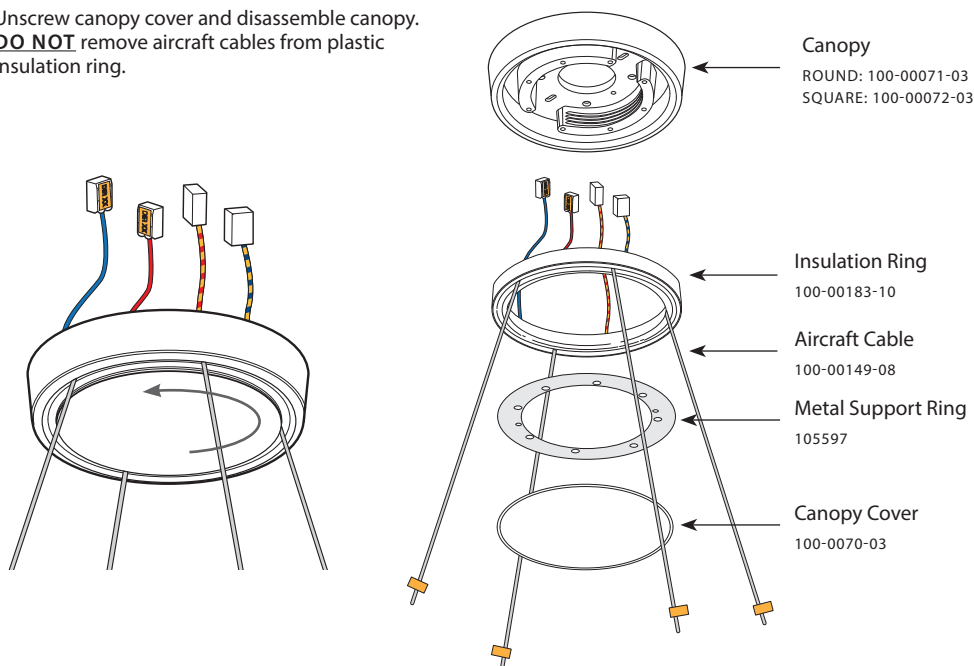

**WARNING:** Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury. Fixture Installations should ONLY be done by a qualified licensed electrical professional.

# Gaze | Round & Square

## Powered Aircraft Cable

### INSTALLATION INSTRUCTIONS

#### X1 — T-BAR — OFF-GRID / X3 — HARD CEILING




PRUDENTIAL LTG.

PRULITE.COM 213.746.0360


**👤👤 MAY REQUIRE TWO PEOPLE TO INSTALL**

#### 4) Mount Canopy.

##### MOUNTING OPTION A & B:

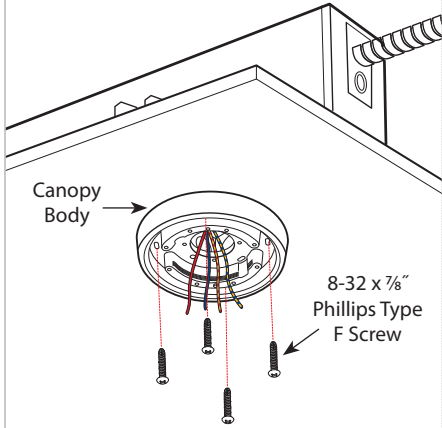


##### MOUNTING OPTION C & D:

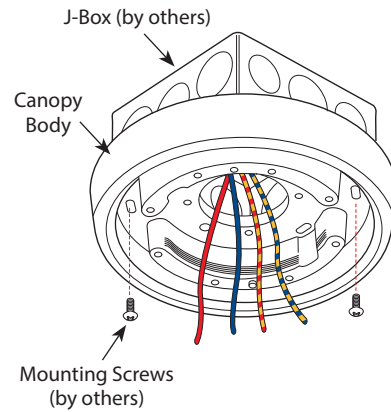

#### 5)

Replace plastic insulation ring with aircraft cables in canopy. Using label IDs and colors, match wires to aircraft cables to make low voltage connections using connectors provided. Fasten metal support ring using (8) 6-32 x 3/8" screws provided.

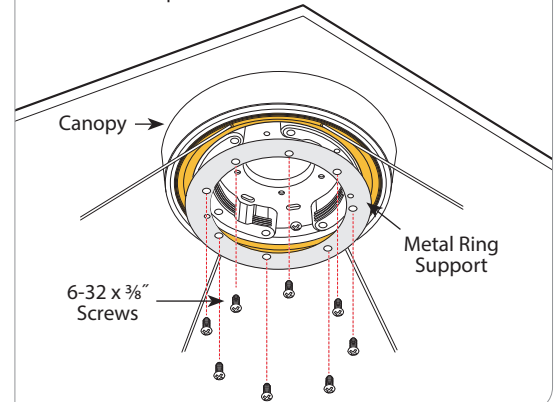

#### THE REMAINING STEPS TO BE USED REGARDLESS OF WHICH MOUNTING OPTION IS USED


#### 6) Locate ID labels on the cable grippers. You will need to know the order of the labels when performing the next installation steps.



##### GRIPPER ID LABELS

Label	Corresponding Low Voltage Wire	Description
DIR 1 +	RED	DIRECT LIGHT DRIVER 1 POSITIVE +
DIR 1 -	BLUE	DIRECT LIGHT DRIVER 1 NEGATIVE -
DIR 2 +	YELLOW/RED	DIRECT LIGHT DRIVER 2 POSITIVE +
DIR 2 -	YELLOW/BLUE	DIRECT LIGHT DRIVER 2 NEGATIVE -
INDIR +	RED/WHITE	INDIRECT LIGHT POSITIVE +
INDIR -	BLUE/WHITE	INDIRECT LIGHT NEGATIVE -
NO POWER	—	NON-POWERED CABLE

#### 7) Using ID labels, match aircraft cable to gripper and hang fixture. Level and position fixture as desired. Aircraft cable position can be adjusted by sliding them within the slots of the plastic insulation ring if needed.

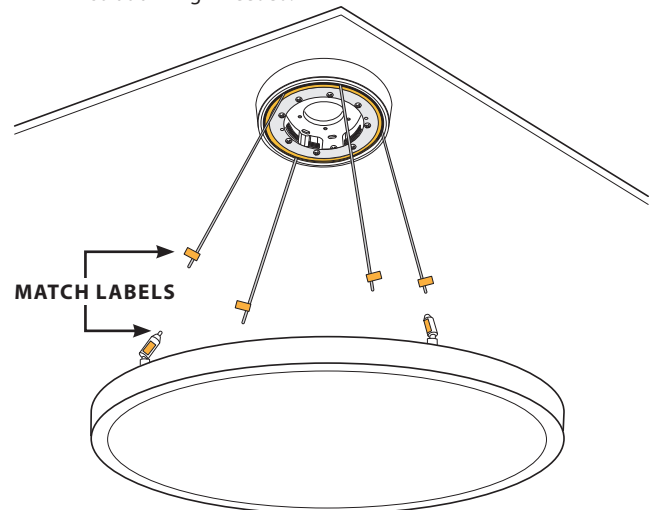

**⚠️ DO NOT** remove grippers.  
**DO NOT** remove labels from grippers.

Crossing the powered aircraft cables may cause the fixture to not light. If fixture does not light see *Trouble Shooting*, page 7.

**WARNING:** Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury. Fixture Installations should ONLY be done by a qualified licensed electrical professional.

# Gaze | Round & Square

## Powered Aircraft Cable

### INSTALLATION INSTRUCTIONS





#### X1 — T-BAR — OFF-GRID / X3 — HARD CEILING



PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

**👤👤 MAY REQUIRE TWO PEOPLE TO INSTALL**

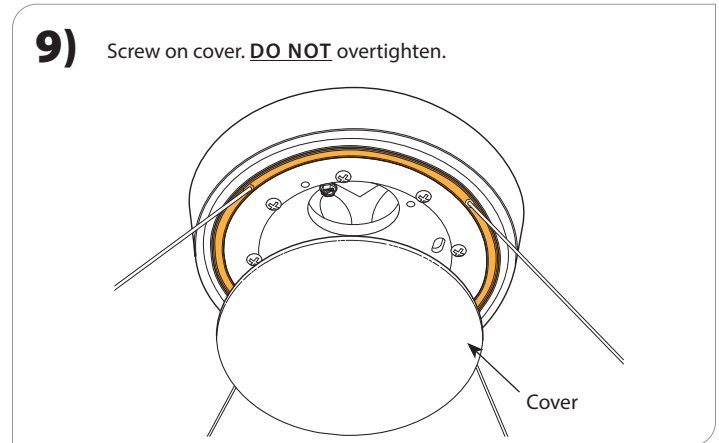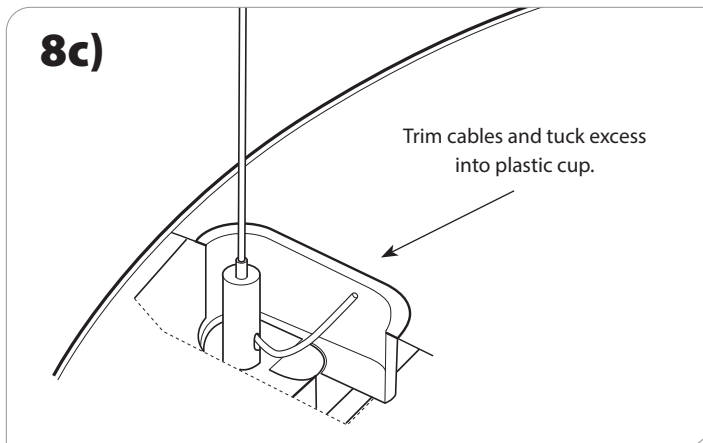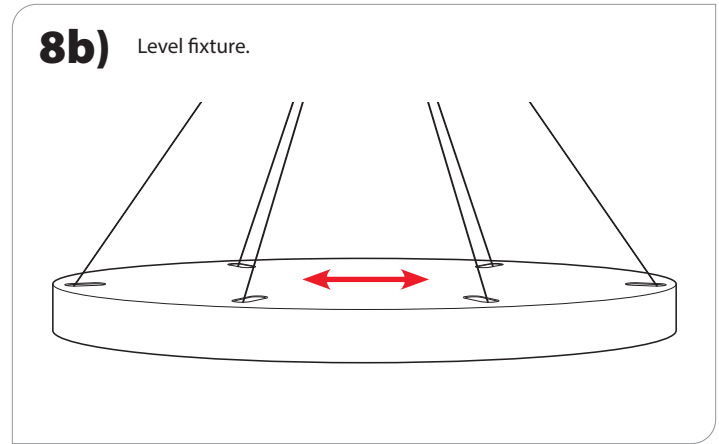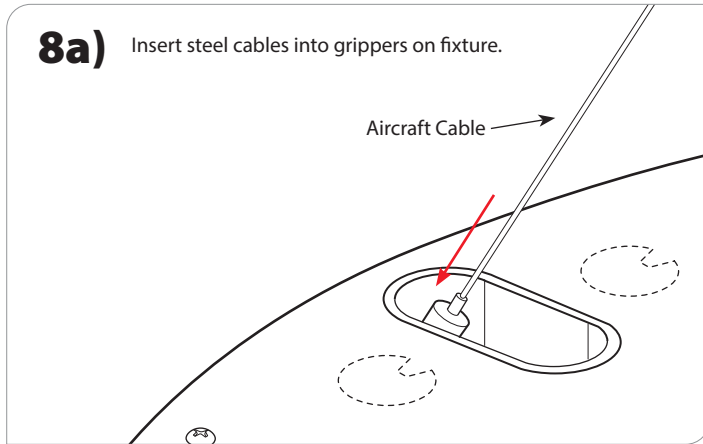

**WARNING:** Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury. Fixture Installations should **ONLY** be done by a qualified licensed electrical professional.



# Gaze | Round & Square Powered Aircraft Cable

## INSTALLATION INSTRUCTIONS

### TROUBLE SHOOTING



PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

#### IF LIGHT FIXTURE DOES NOT LIGHT UP

- Check aircraft cable is not making contact with any metal besides cable gripper (step 8).
- Double check that the low voltage wire color and ID labels match at the four following locations (Use 5A and 5B as reference).  
Colored wires connected to LED drivers → Wire connector behind canopy cover → Aircraft cable → Cable gripper.
- With fixture powered on, use multimeter to check each set of powered aircraft cables.  
Ensure you are checking a matching pair, i.e. "DIR 1+ and DIR 1-". You should get a voltage reading of 31 – 35 volts.  
If you get a voltage reading higher or lower than this, you may have a poor connection somewhere.
- With fixture power on, use multimeter to check line voltage power to LED drivers.
- If the fixture still does not light up, contact the factory for further troubleshooting.

**WARNING:** Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury.  
Fixture Installations should ONLY be done by a qualified licensed electrical professional.



Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit [prulite.com](http://prulite.com) for most current data.  
© 2025 All rights reserved – All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058