


Pru1 Chandeleirs

Mounting

INSTALLATION INSTRUCTIONS

PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

PART	PART NO.	DESCRIPTION	QTY
	—	8-32 x ½″ Machine Screw	2
	**100-00651-14**	In-Line Strain Relief (For Cable Versions Only)	1
	**100-00020-31**	Louver (Optional)	
	**100-00021-31**	Softening Lens (Optional)	
	**100-00025-31**	Magnetic Ring Holder (Optional)	
	**(by others)**	3″ Octagon J-Box	
	**(by others)**	4″ Octagon J-Box	

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury
Fixture Installations should ONLY be done by a qualified licensed electrical professional..

USA

Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2026 All rights reserved—All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058

Pru1 Chandeleirs

Mounting

INSTALLATION INSTRUCTIONS

PRUDENTIAL LTG.


PRULITE.COM 213.746.0360


1) Remove (x4) canopy screws to access mounting plate.

2) Make all necessary power supply connections via J-box.

3) Attach mounting plate to j-box with provided 8-32 screws.

4) Re-install (x4) canopy screws to mounting plate.

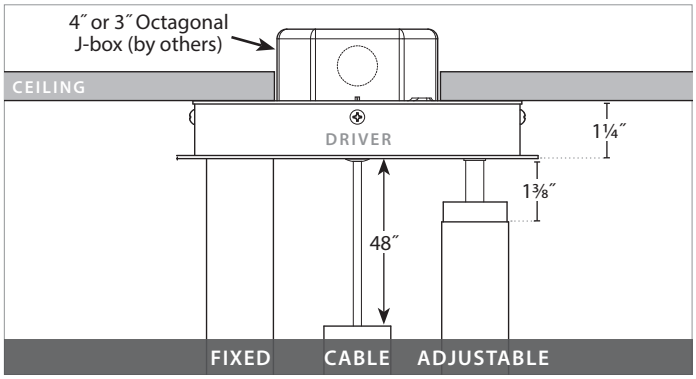

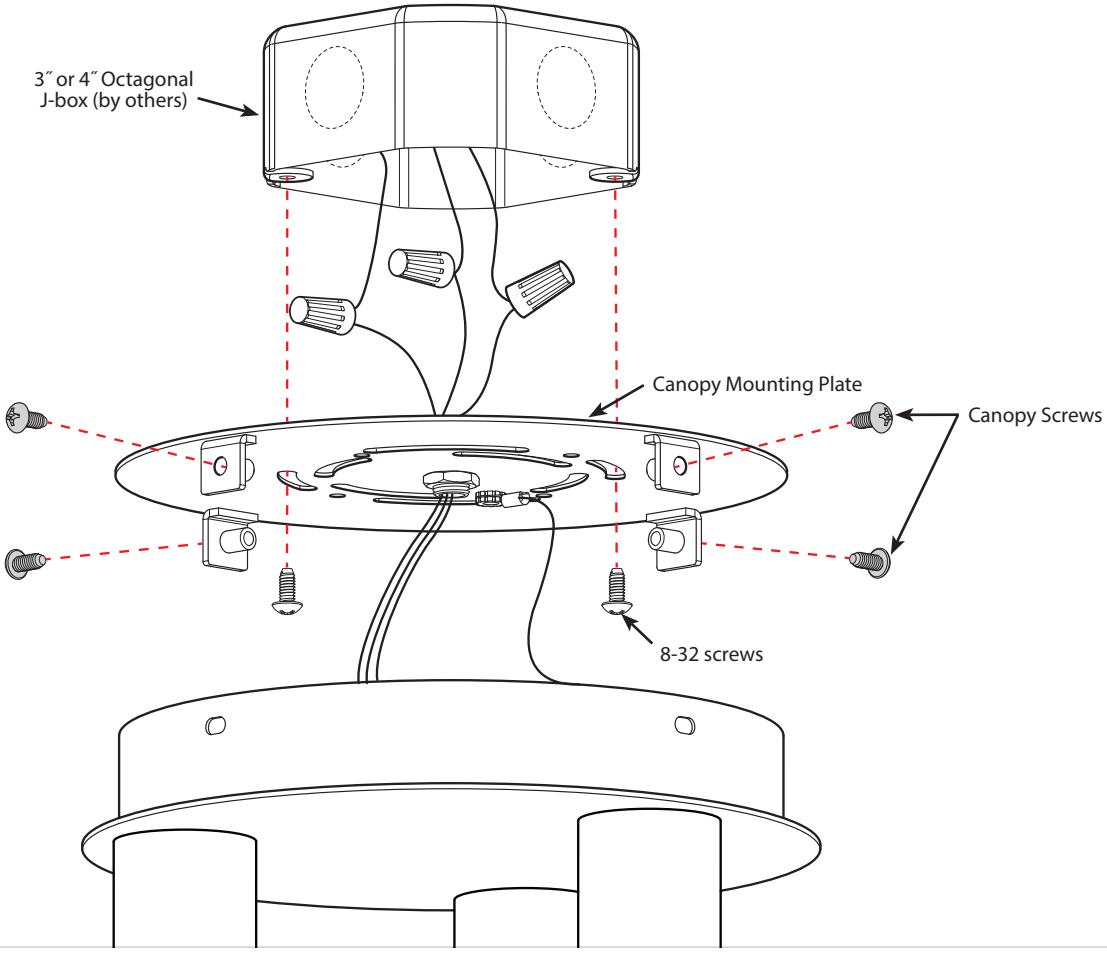

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury
Fixture Installations should ONLY be done by a qualified licensed electrical professional..

USA
Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2026 All rights reserved—All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058

Pru1 Chandeleirs

Mounting


INSTALLATION INSTRUCTIONS


PRUDENTIAL LTG.

PRULITE.COM 213.746.0360

SUPPLEMENTAL INSTRUCTIONS FOR CABLE VERSION


To adjust suspension height, slide power cord through strain relief as shown. Cut extra cord and make electrical connections.

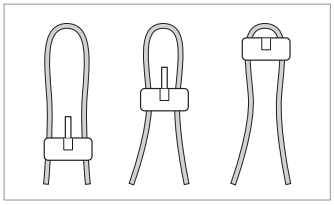

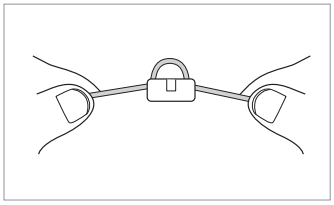

OPTIONAL

Install optical accessories.
Ensure the magnetic ring holder is installed last.

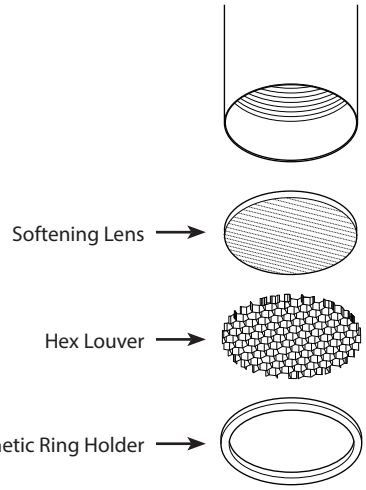

WARNING: Ground fixture in accordance with local and national electrical codes. Failure to do so may result in serious personal injury
Fixture Installations should ONLY be done by a qualified licensed electrical professional..

Prudential Ltg. reserves the right to change design specifications or materials without notice. Please visit prulite.com for most current data.
© 2026 All rights reserved—All products manufactured at: Prudential Ltg. 1774 E. 21st Street, Los Angeles, CA 90058